
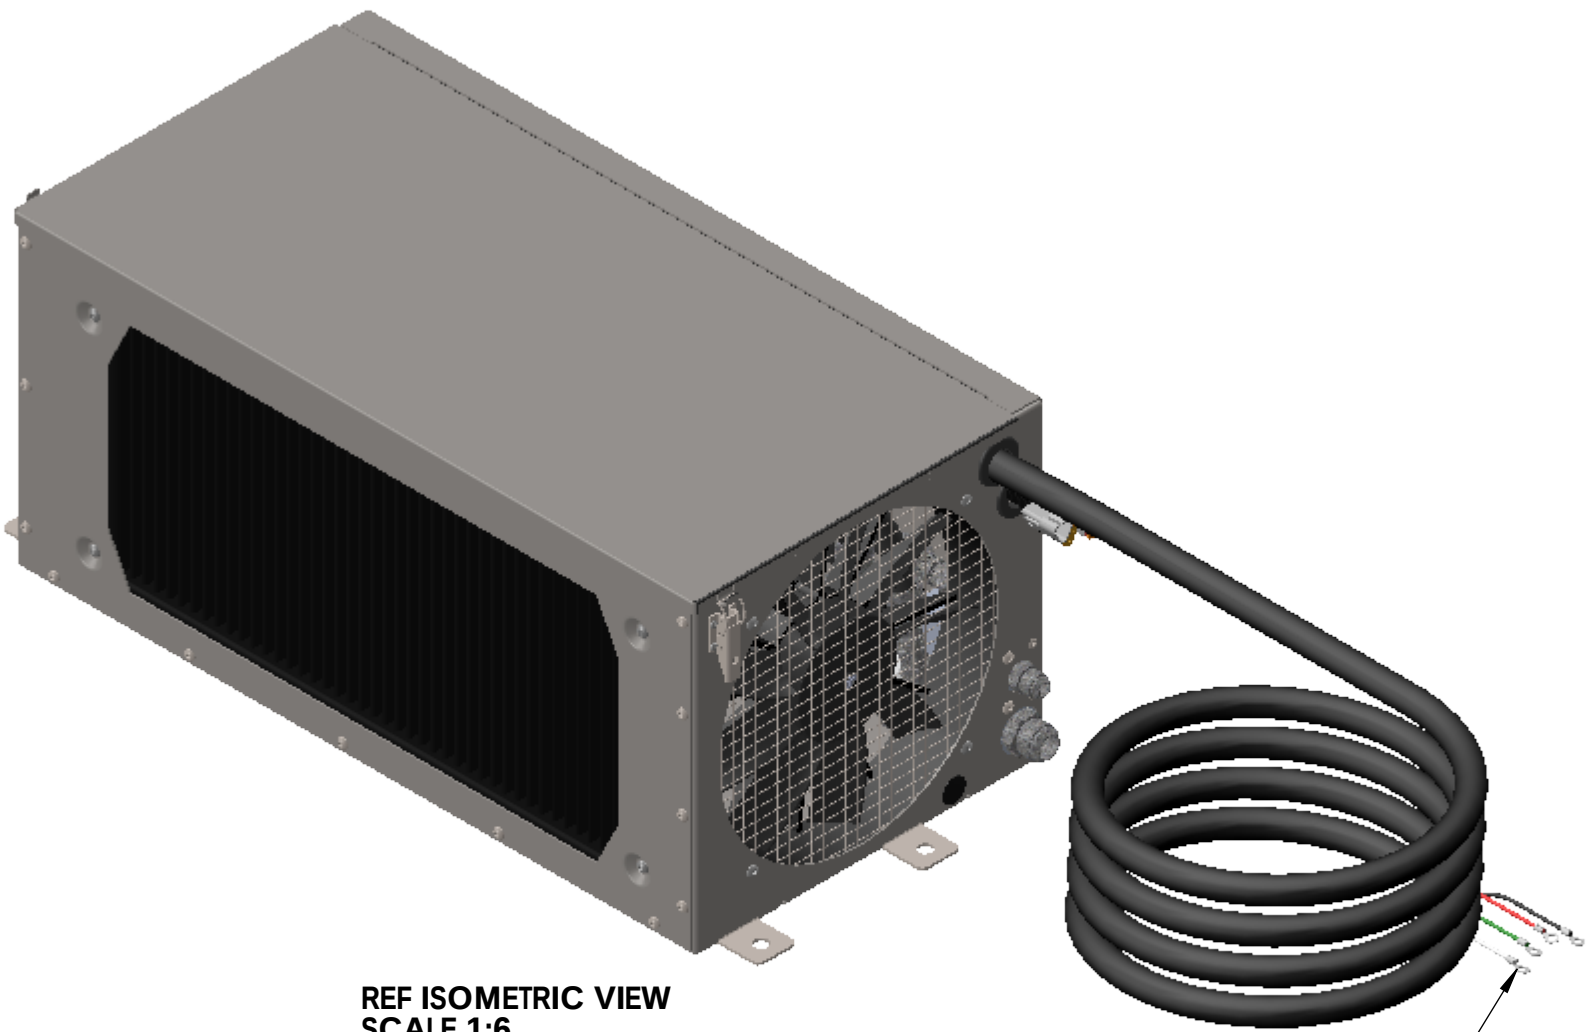






NOTES:

1. ASSEMBLY IS 100% PRODUCTION TESTED
2. ENCLOSURE: 304 STAINLESS STEEL
3. INTERNAL HYDRAULIC RESERVOIR
4. DIMENSION TOLERANCE +/- 0.125"
5. ASSEMBLY MUST BE MOUNTED SO AS TO PREVENT RECIRCULATION OF HOT AIR EXHAUST FROM COOLER
6. REF. DRAWING 17XXXXX MODEL MATRIX FOR SYSTEM DETAILS

REVISIONS			
REV.	DATE	BY	DESCRIPTION
C	8/17/2018	CML	REVISED AND REDRAWN PER ECO #16374

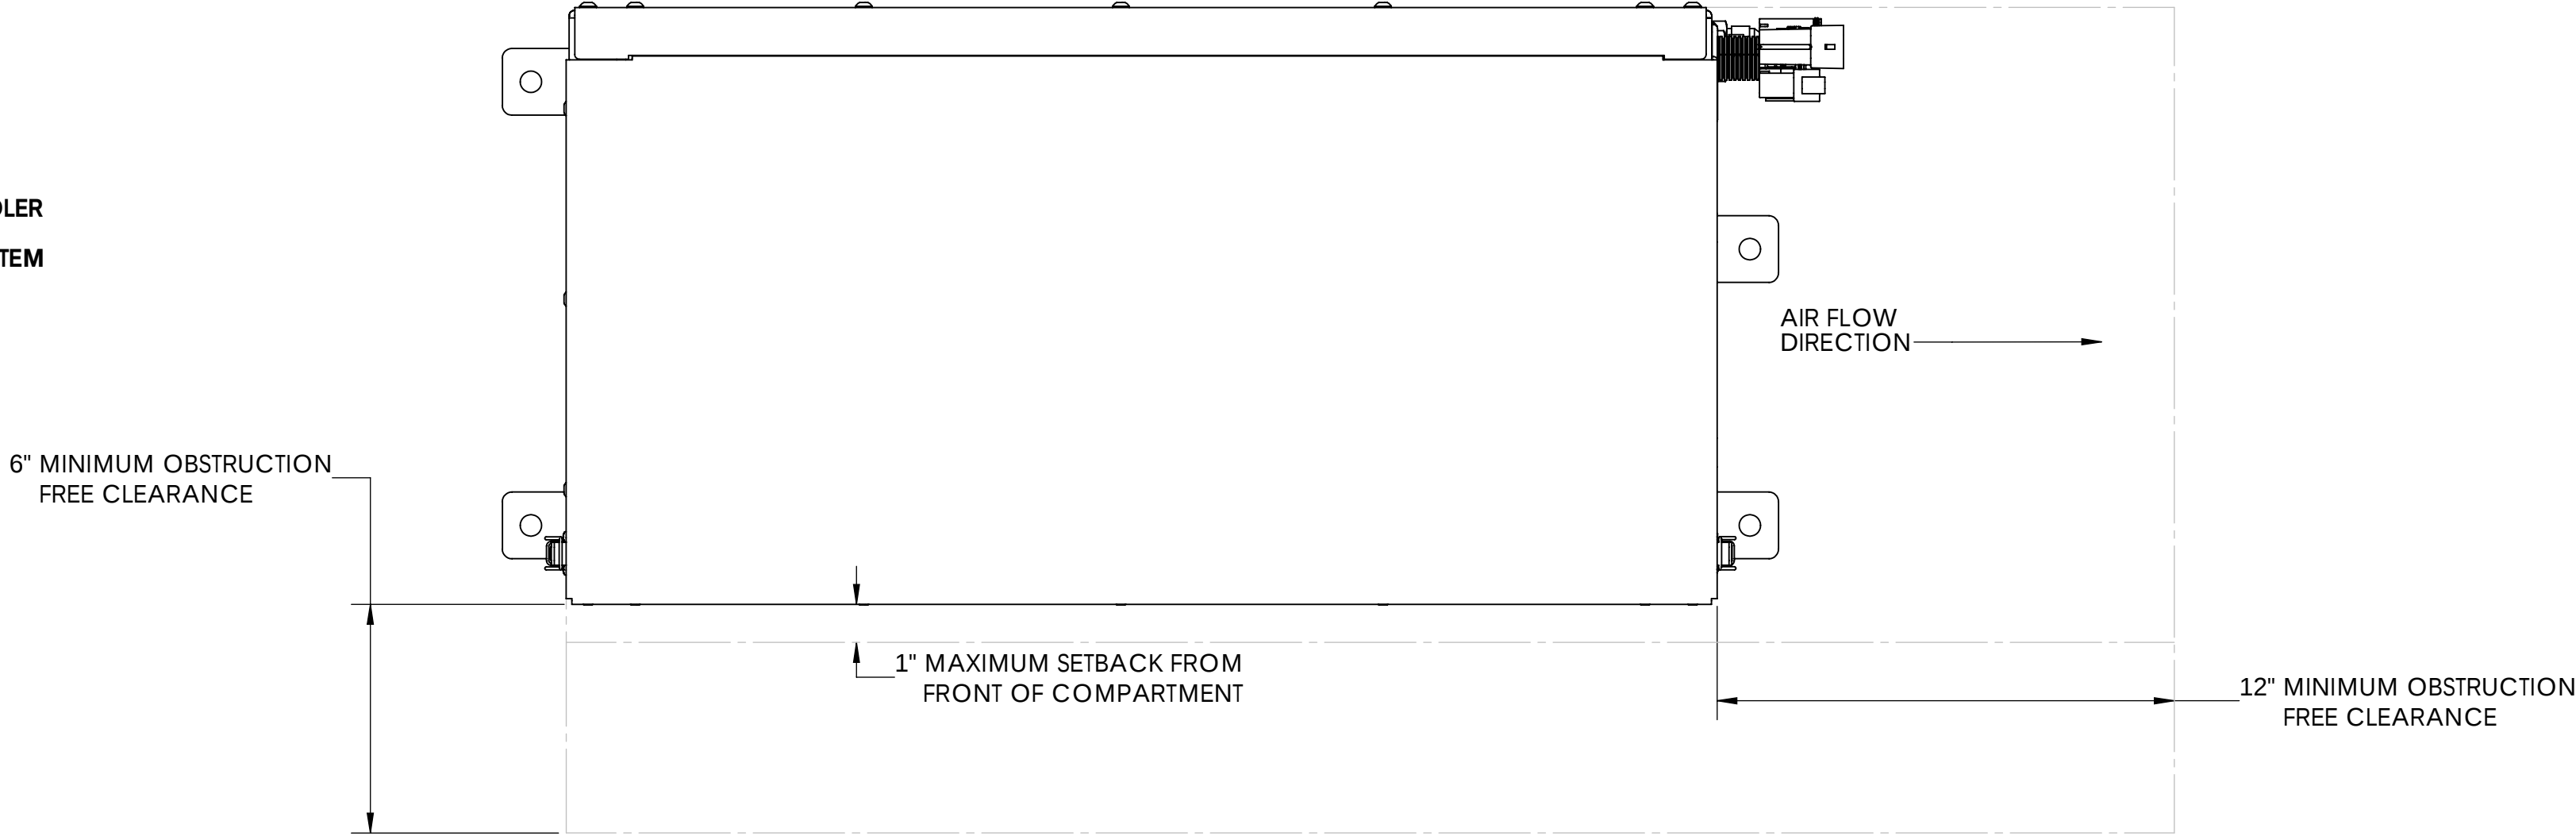

GENERATOR AC OUTPUT HARNESS (INCLUDED) - 15FT +/- 1FT
GREEN - GROUND
WHITE - NEUTRAL
BLACK - 240V, L1
RED - 240V, L2
CONDUIT (FNMC)

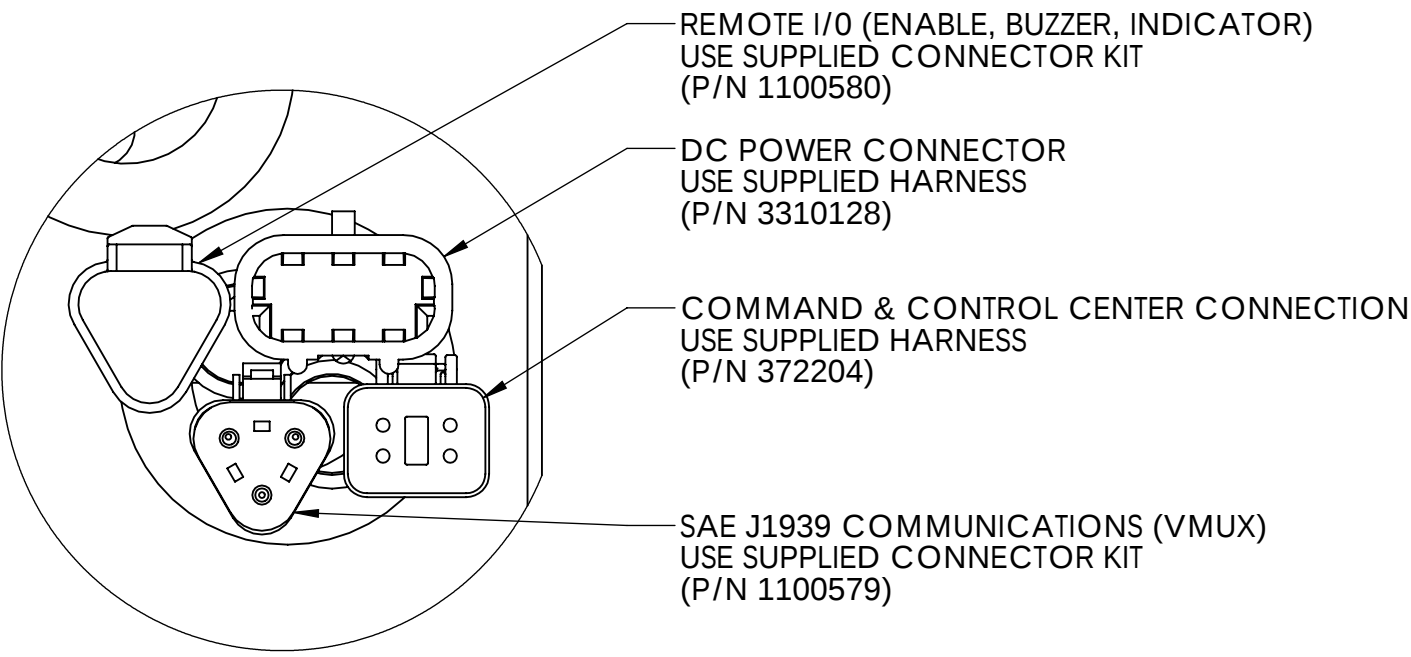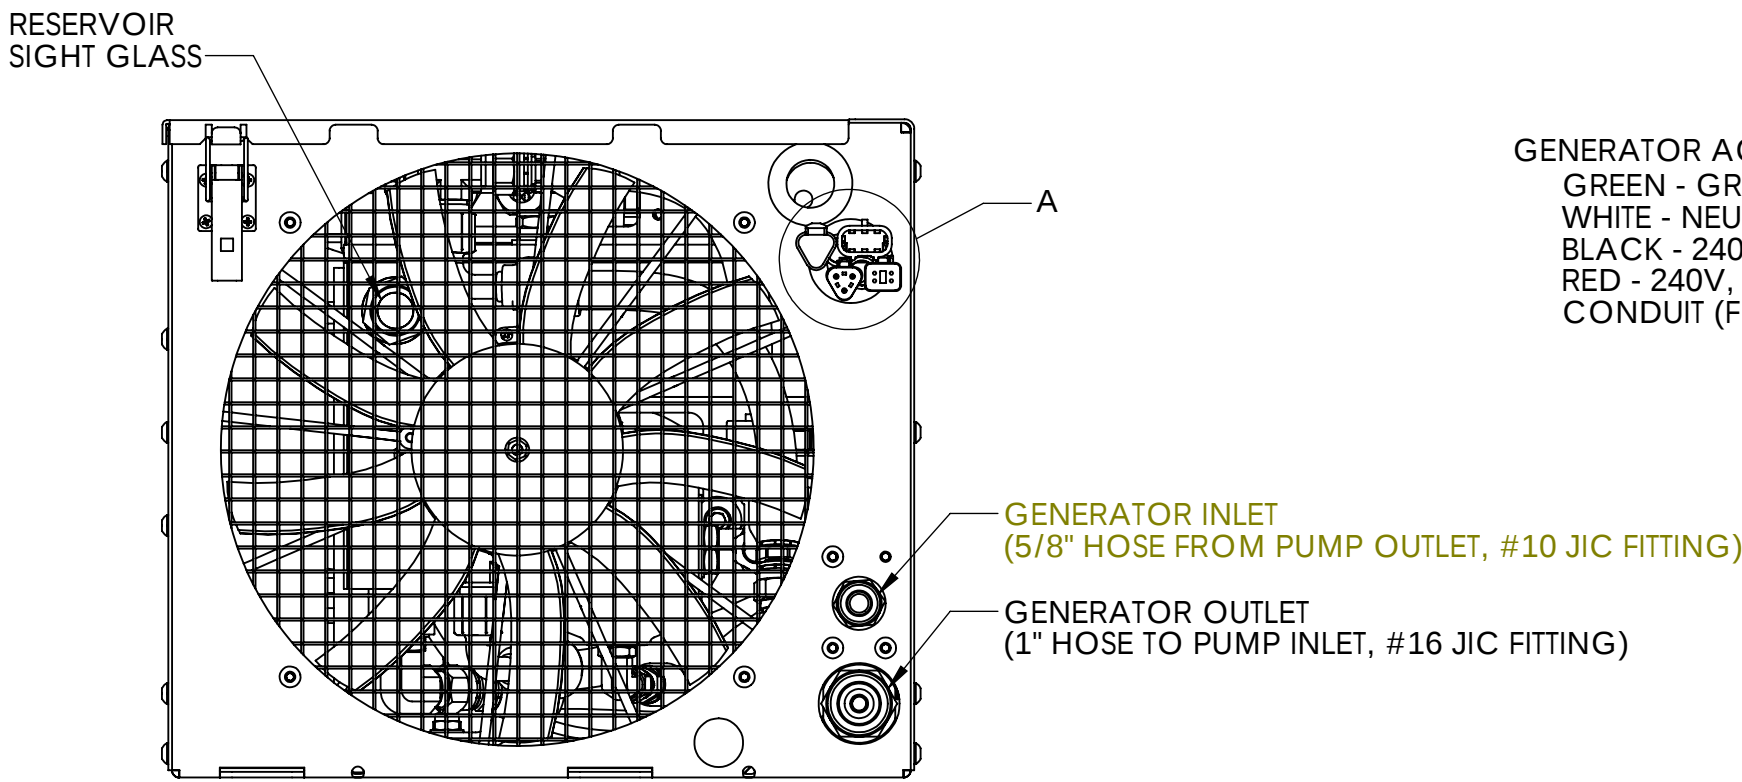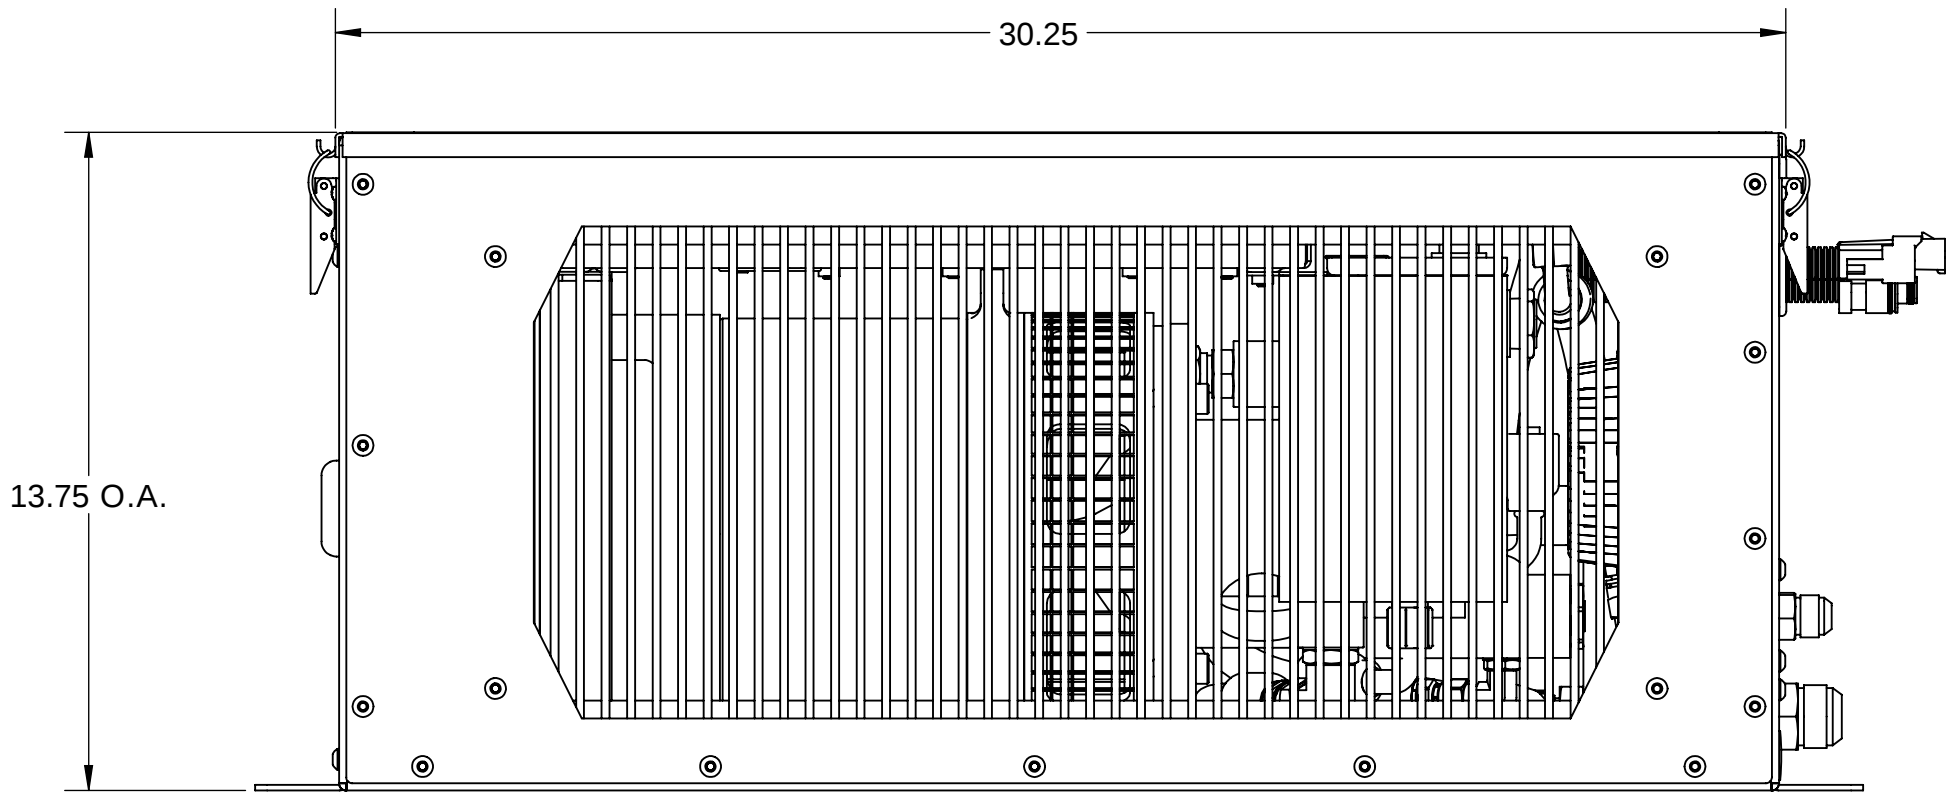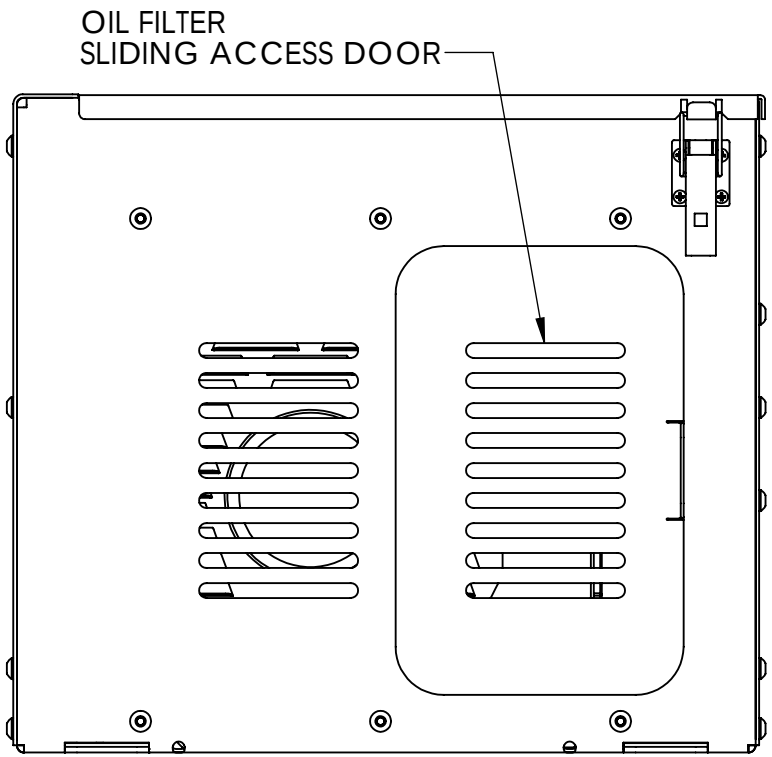

DETAIL A
SCALE 1 : 1

PROPRIETARY DATA
STRICTLY CONFIDENTIAL
NARTRON

SW

COMPUTER GRAPHICS
NO HAND REVISIONS

THIS DOCUMENT IS THE PROPERTY OF NARTRON AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN NARTRON AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS INFORMATION CONTAINED HEREIN OR TO REPRODUCE ALL OR ANY PART OF THIS DOCUMENT.

DELIVERY OF THIS DOCUMENT BY NARTRON CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.

SPECIFICATION CONTROL DRAWING

DRAWN	DATE	REQ'D	ITEM	PART NO	DESCRIPTION
CML	08-17-18	DO NOT SCALE		LIST OF MATERIALS	
CHECKED	DATE	DIMENSIONS ARE IN INCHES			REED CITY, MI 49677 DIVISION
DRM	8-30-18	TOLERANCE UNLESS OTHERWISE SPECIFIED			
APPROVED	DATE				
BDL	8-30-18				
MATERIAL				NAME	
2 PLACE DECIMALS 00.01				ELECTRONIC CONTROL TRAY ASM, LR 6.2-kW COMPARTMENT MOUNT	
3 PLACE DECIMALS 00.005					
NEXT ASSEMBLY				NO	
ANGLES 01/2°				SCALE 1:4	
THDS. INT 2B EXT 2A				SHEET 1 OF 1	
				8570106	