

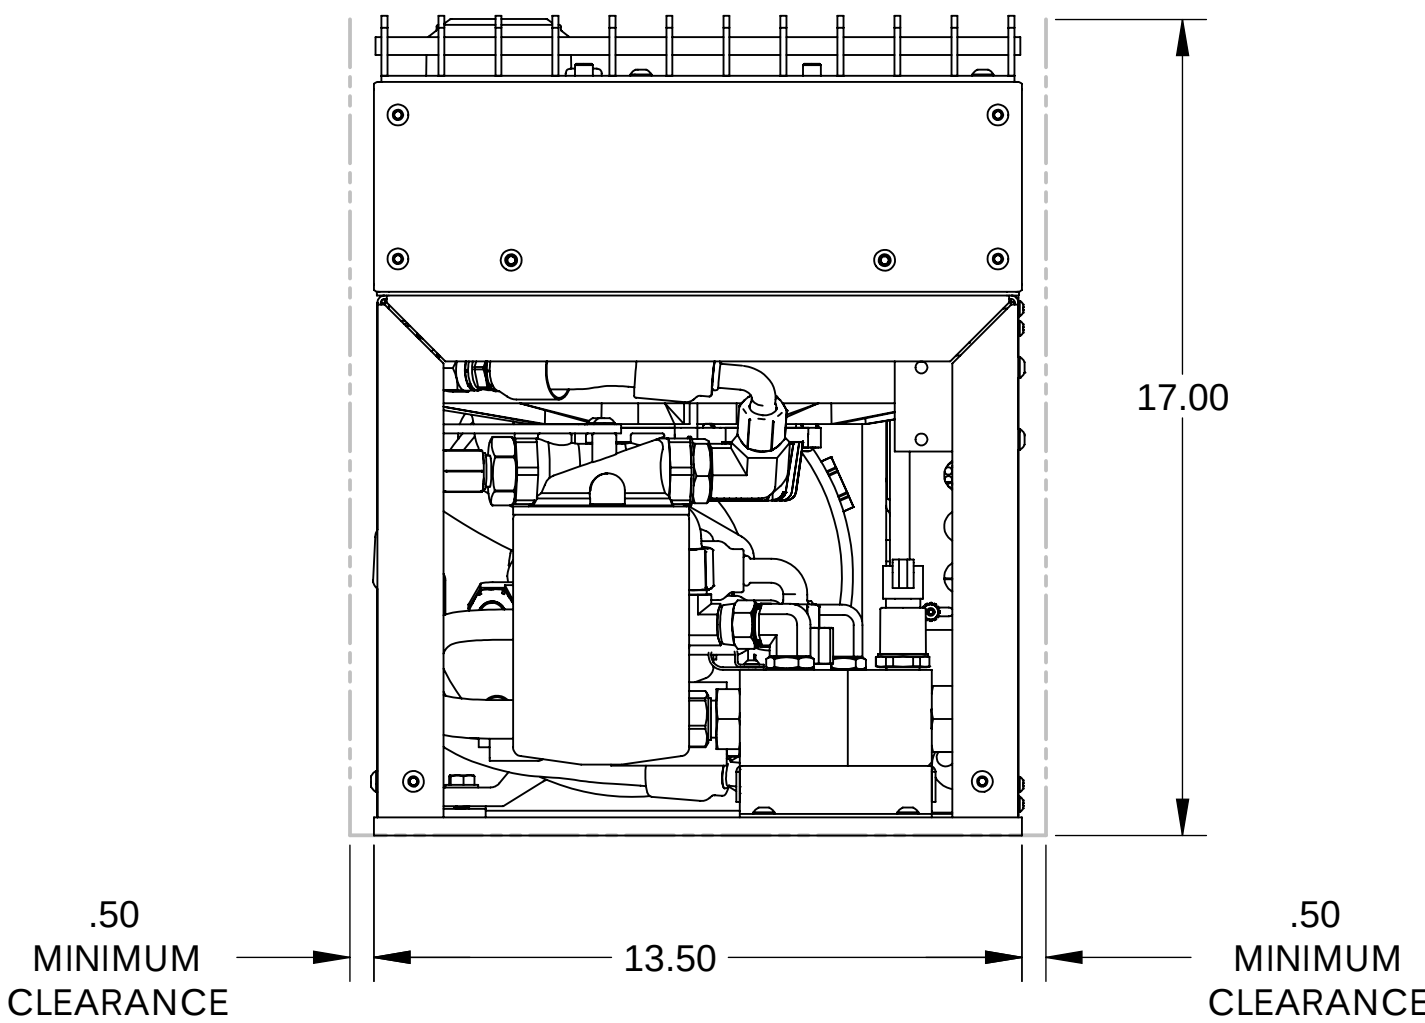
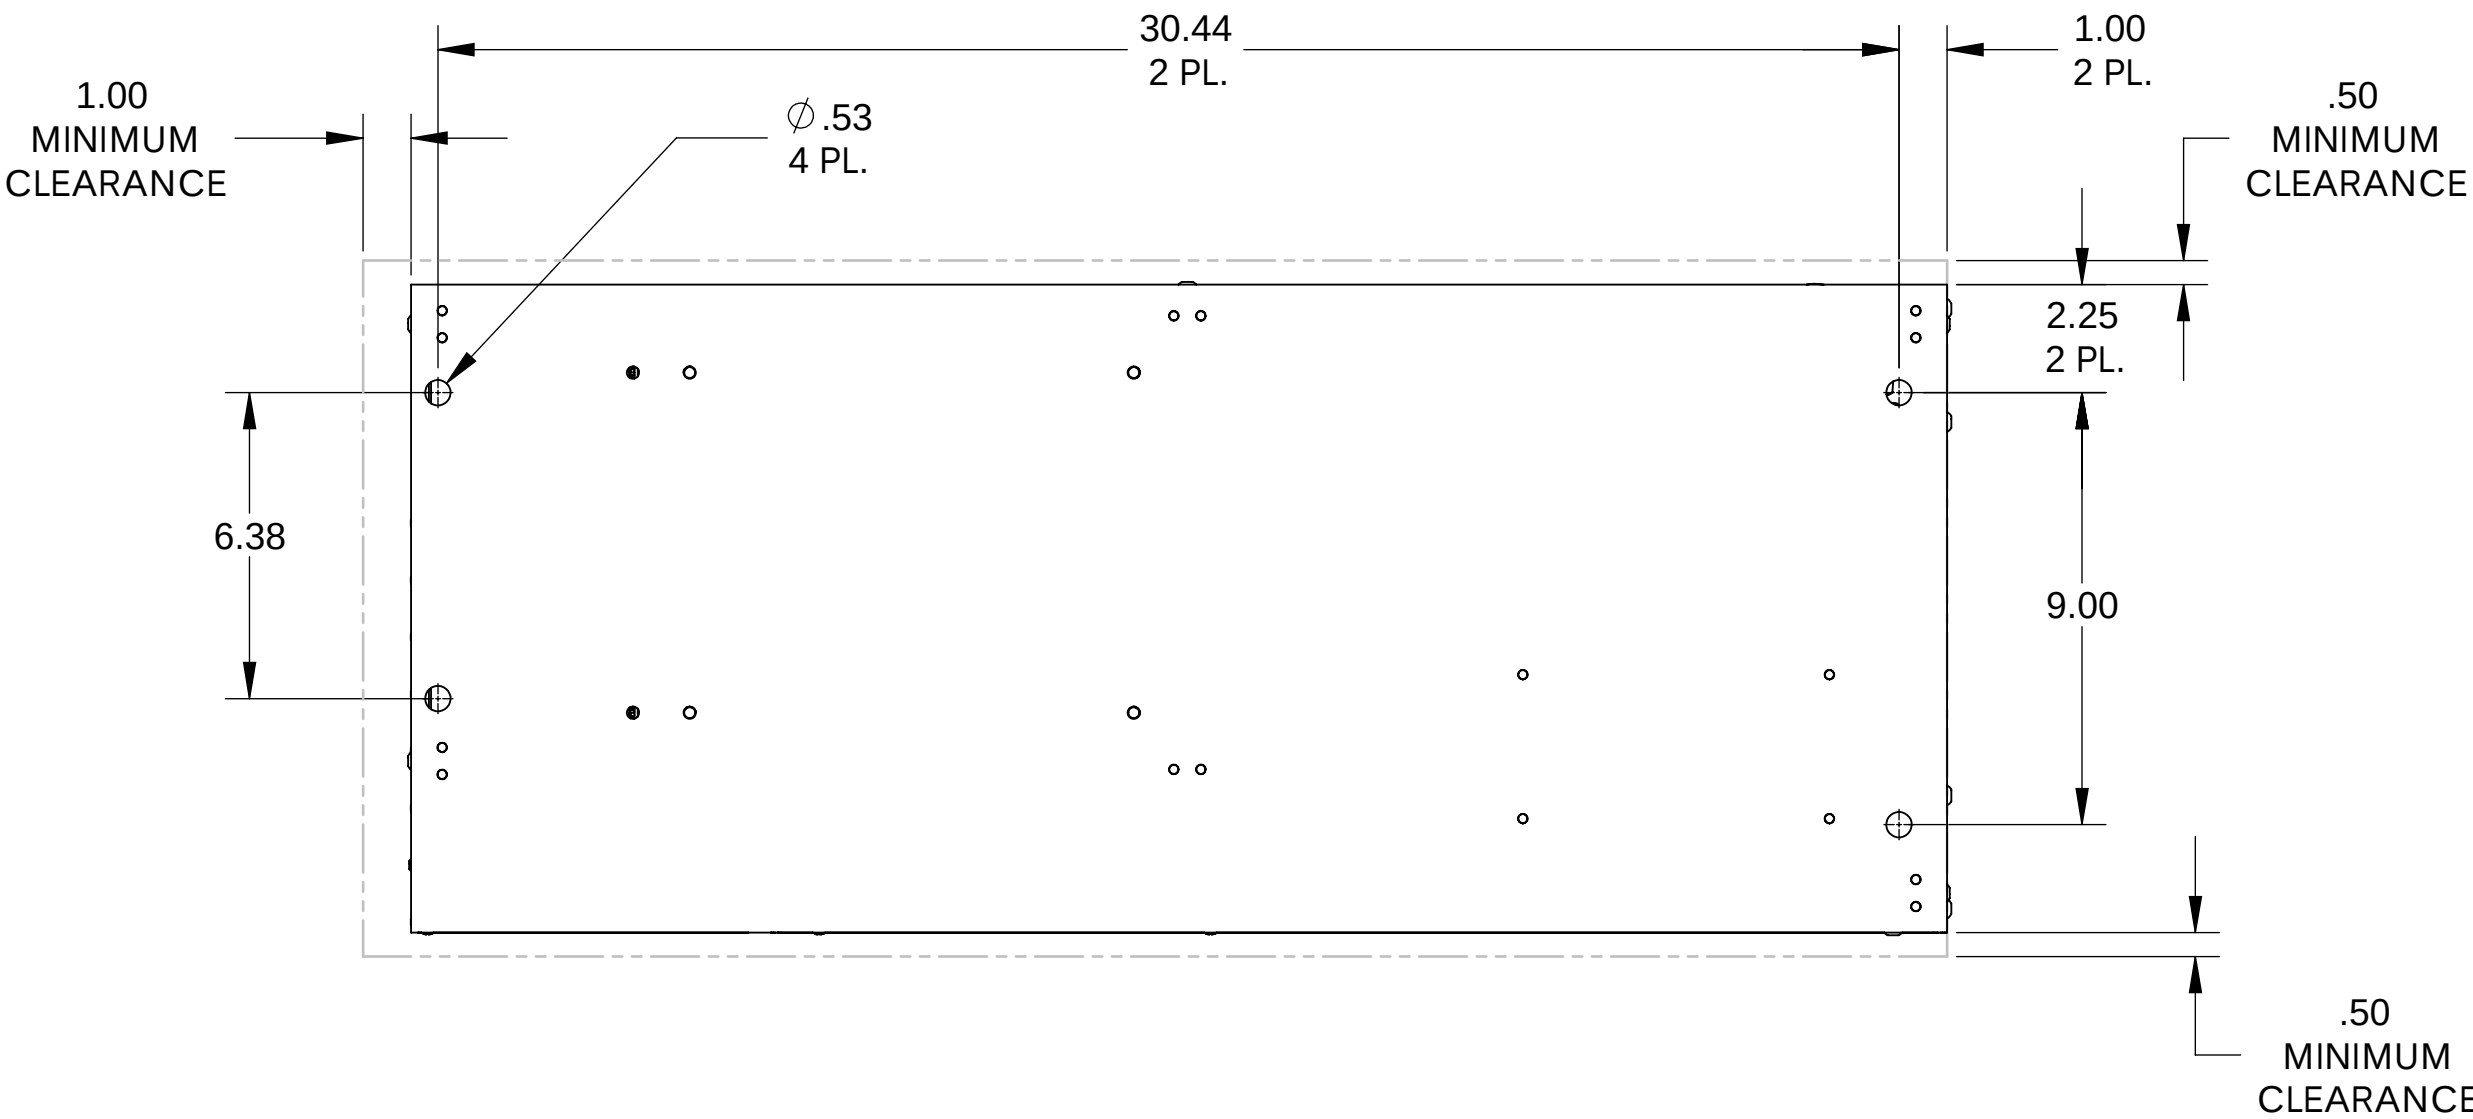
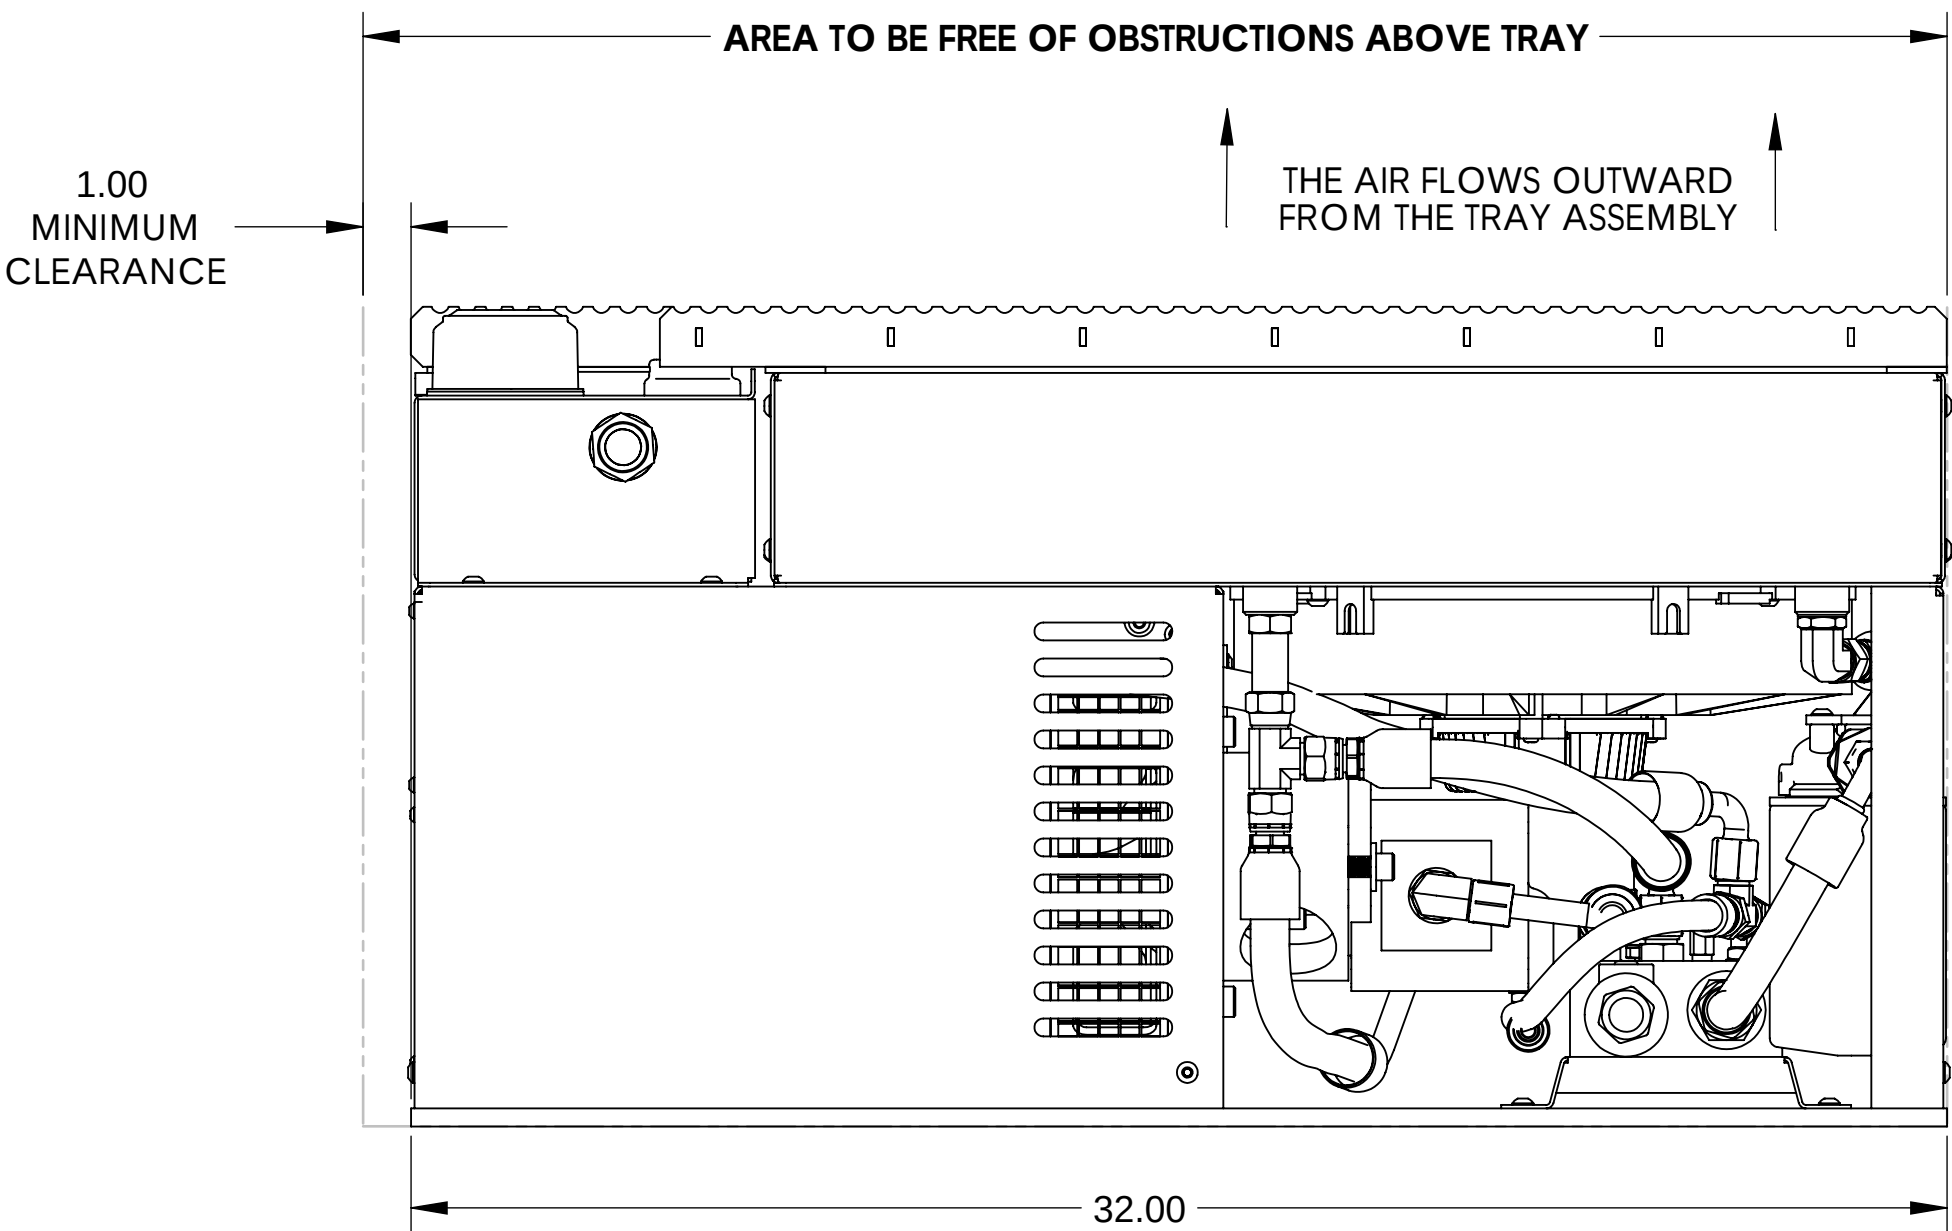
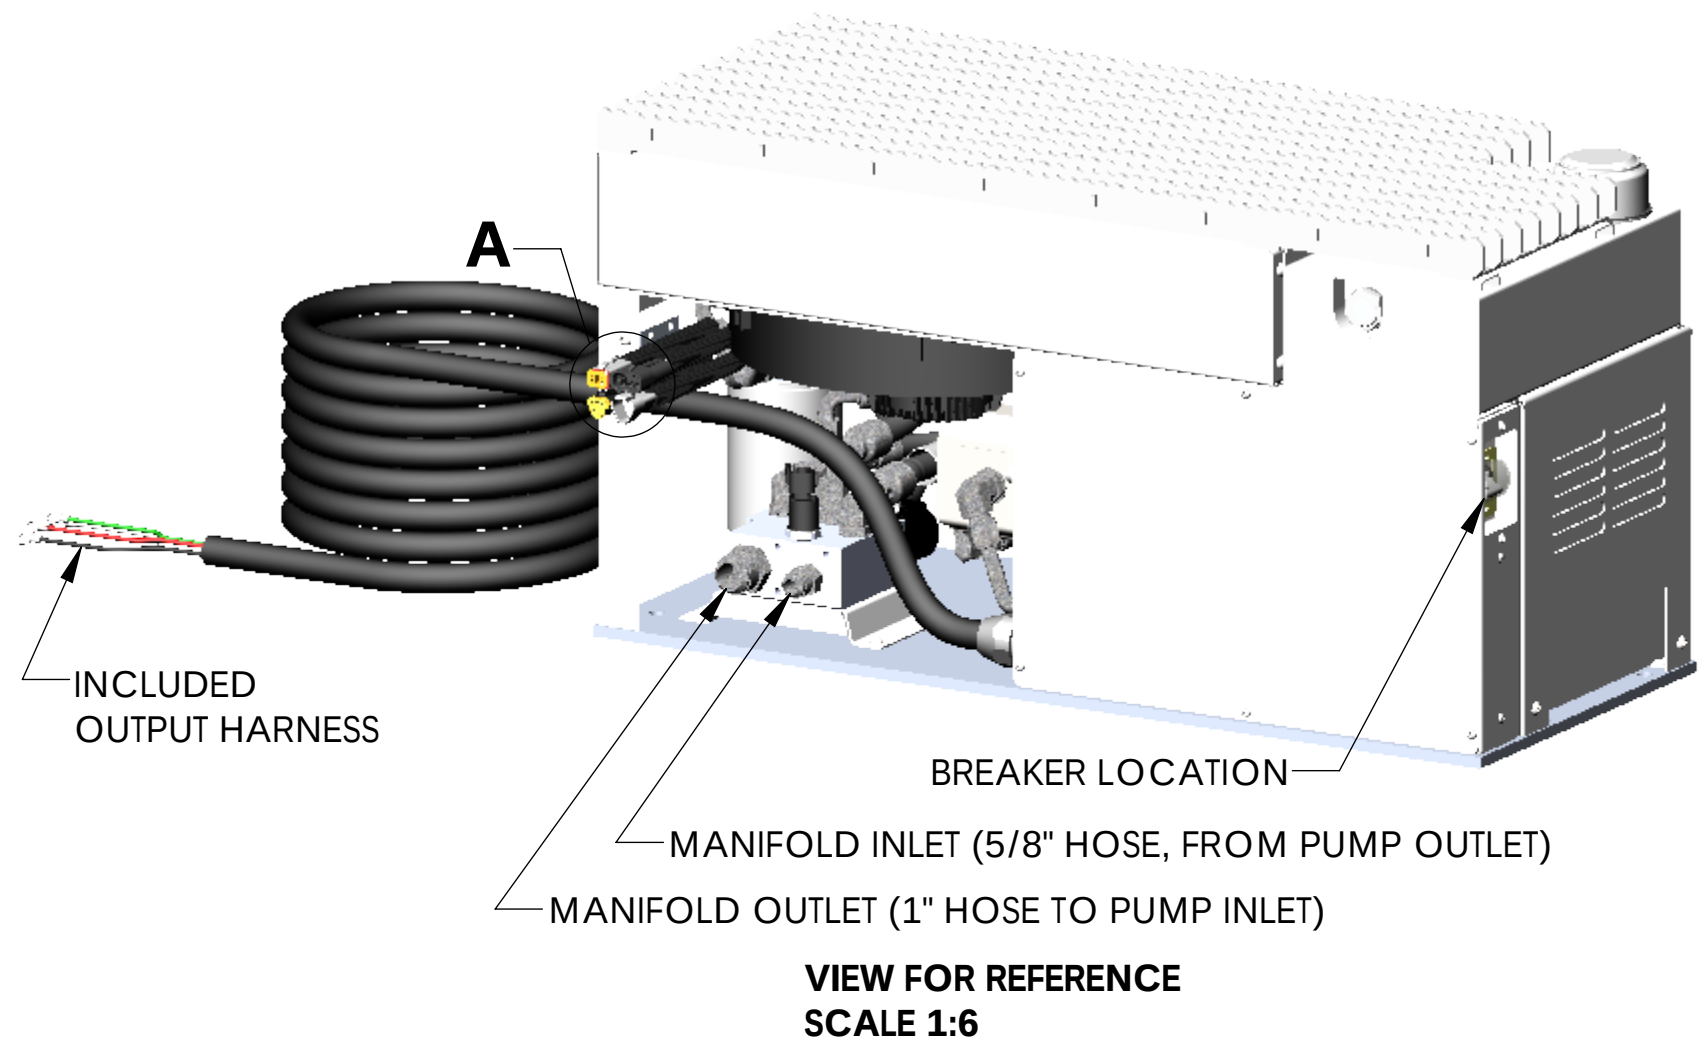
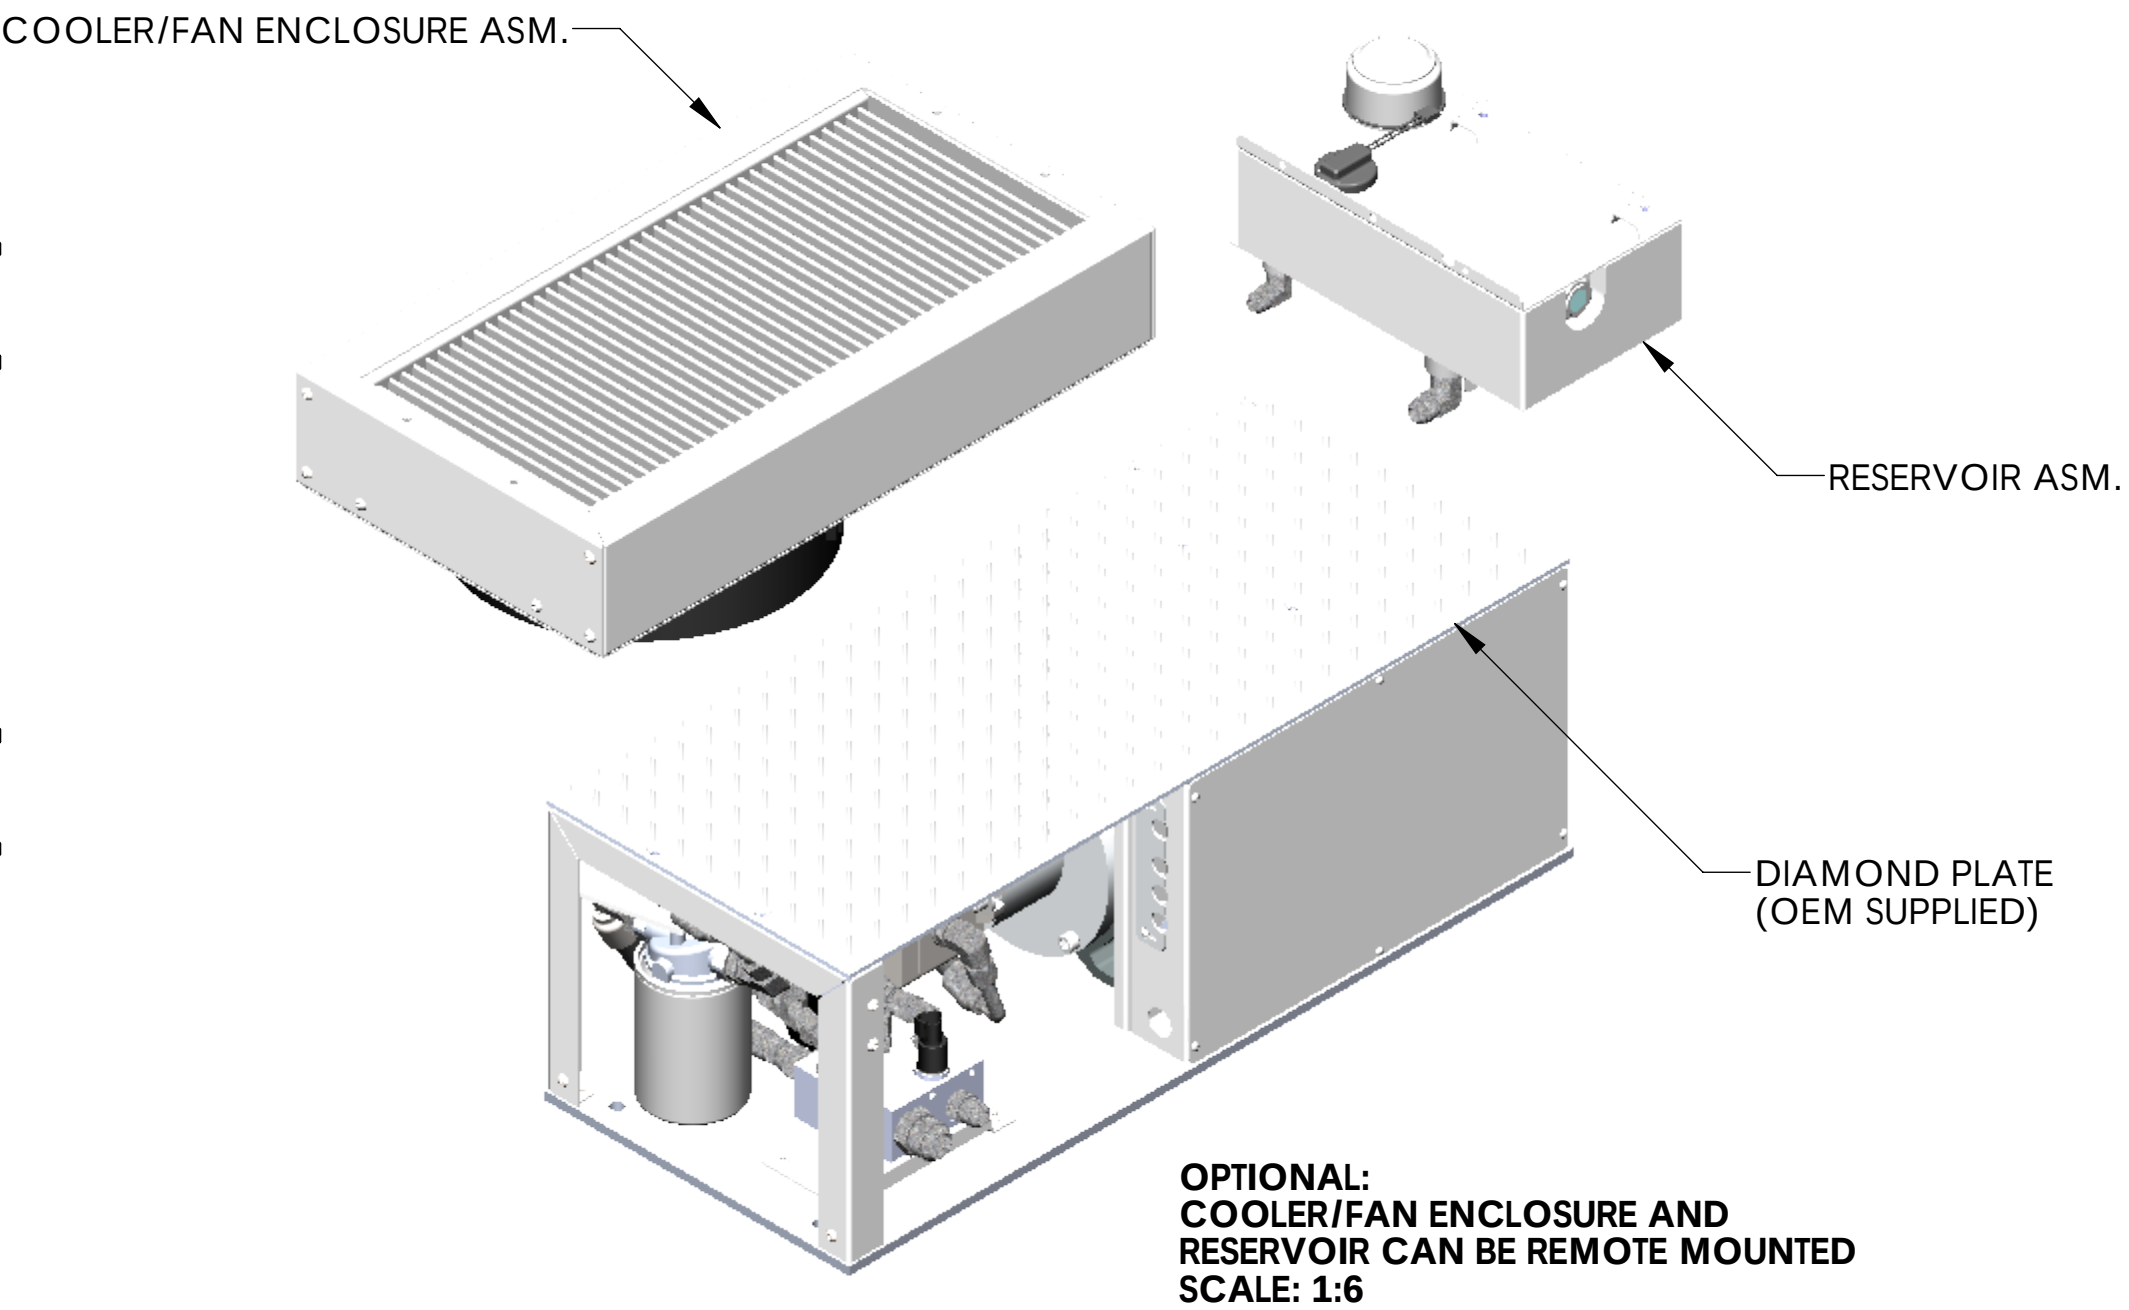


REVISIONS			
REV.	DATE	BY	DESCRIPTION
A	9/22/2012	DLS	RELEASED PER ECO #15720
B	1/5/2017	CML	UPDATED ALTERNATOR AND FAN PER ECO #16282
C	9/7/2018	CML	UPDATED SYSTEM CONTROLLER PER ECO #16376

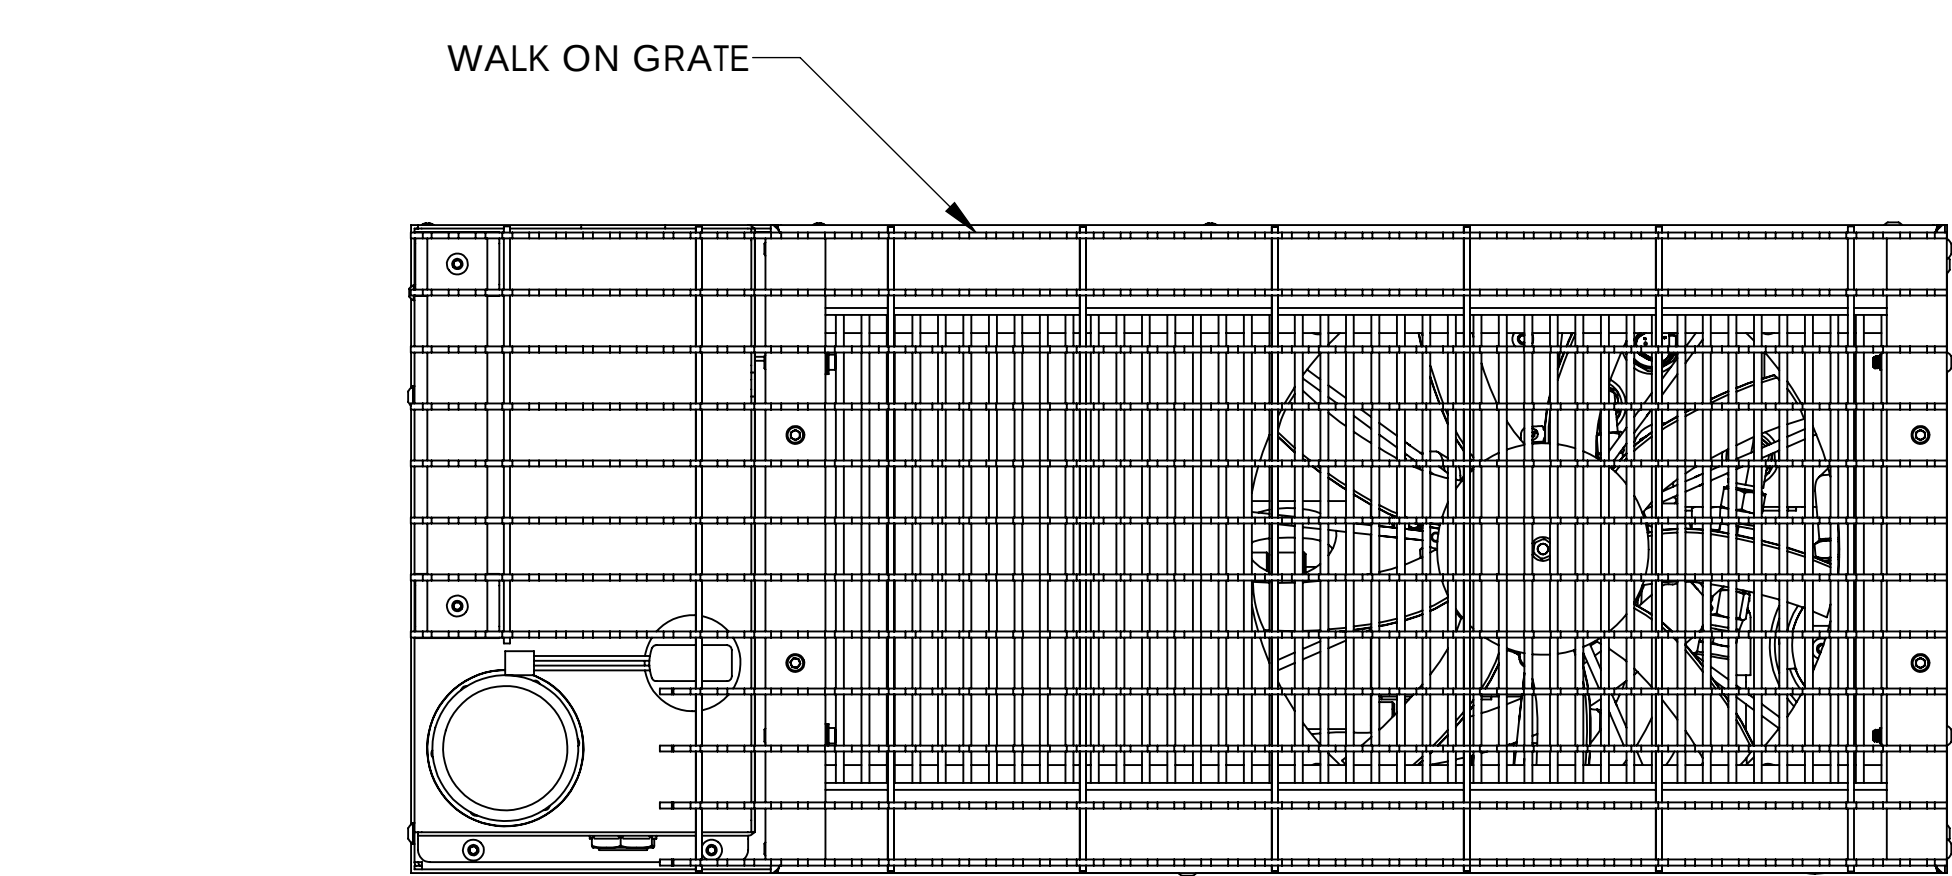

- NOTE:
- ASSEMBLY IS 100% PRODUCTION TESTED
 - DIMENSION TOLERANCE : ± 0.125
 - RESERVOIR ASSEMBLY CAN BE REMOVED FROM FRAME ASSEMBLY AND REMOTELY MOUNTED
 - TRAY ASSEMBLY MUST BE MOUNTED SO AS TO PREVENT RECIRCULATION OF HOT AIR EXHAUST FROM COOLER
 - GENERATOR OUTPUT WIRE ASSEMBLY: 15FT $\pm$ 1FT LONG
GREEN WIRE, 10AWG - GROUND
WHITE WIRE, 10AWG - NEUTRAL
BLACK WIRE, 10AWG - 240V, L1
RED WIRE, 10AWG - 240V, L2
CONDUIT, (FNMC)
 - REF. DRAWING 26XXXXX MODEL MATRIX FOR SYSTEM DETAILS

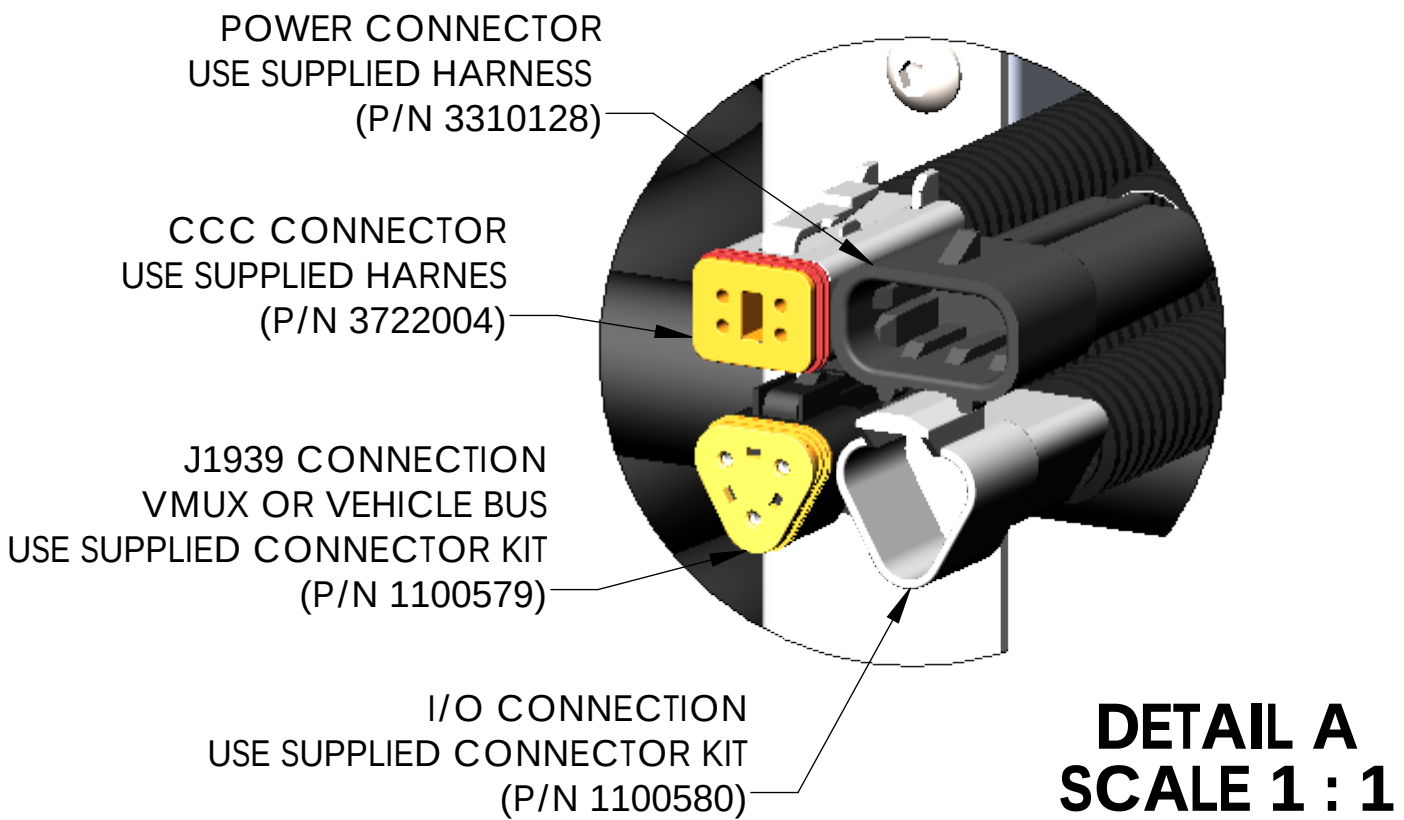

PROPRIETARY DATA
STRICTLY CONFIDENTIAL
NARTRON

SPECIFICATION CONTROL DRAWING

SW COMPUTER GRAPHICS NO HAND REVISIONS	
THIS DOCUMENT IS THE PROPERTY OF NARTRON AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN NARTRON AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS INFORMATION CONTAINED HEREIN OR TO REPRODUCE ALL OR ANY PART OF THIS DOCUMENT.	
DELIVERY OF THIS DOCUMENT BY NARTRON CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.	

DRAWN	DATE	REQ'D	ITEM	PART NO	DESCRIPTION
DLS	09-12-12	DO NOT SCALE			LIST OF MATERIALS
CHECKED	DATE	DIMENSIONS ARE IN INCHES			
JMT	09-18-12				
APPROVED	DATE	TOLERANCE UNLESS OTHERWISE SPECIFIED			
AEB	09-19-12				
MATERIAL		2 PLACE DECIMALS ± 0.01			
		3 PLACE DECIMALS ± 0.005			
NEXT ASSEMBLY		ANGLES $\frac{1}{16}$ 2A	SCALE	1/4 SIZE	NO
		THDS. INT 2B EXT 2A	SHEET	1 OF 1	



REED CITY, MI 49677

ELECTRONIC CONTROL TRAY ASM,
6.2-kW LRT TOP MOUNT

8583146