

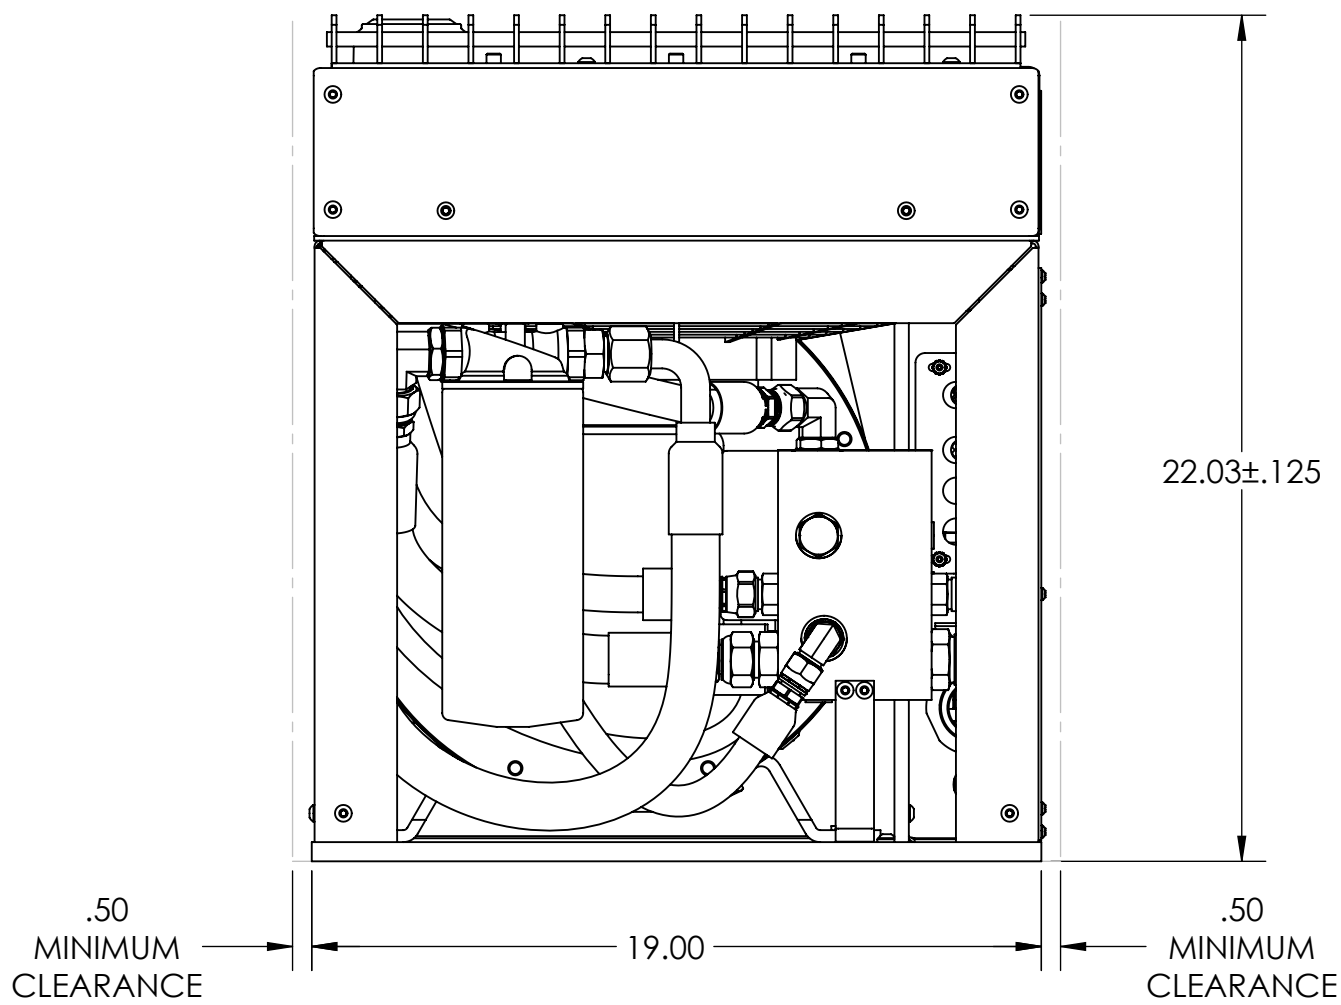
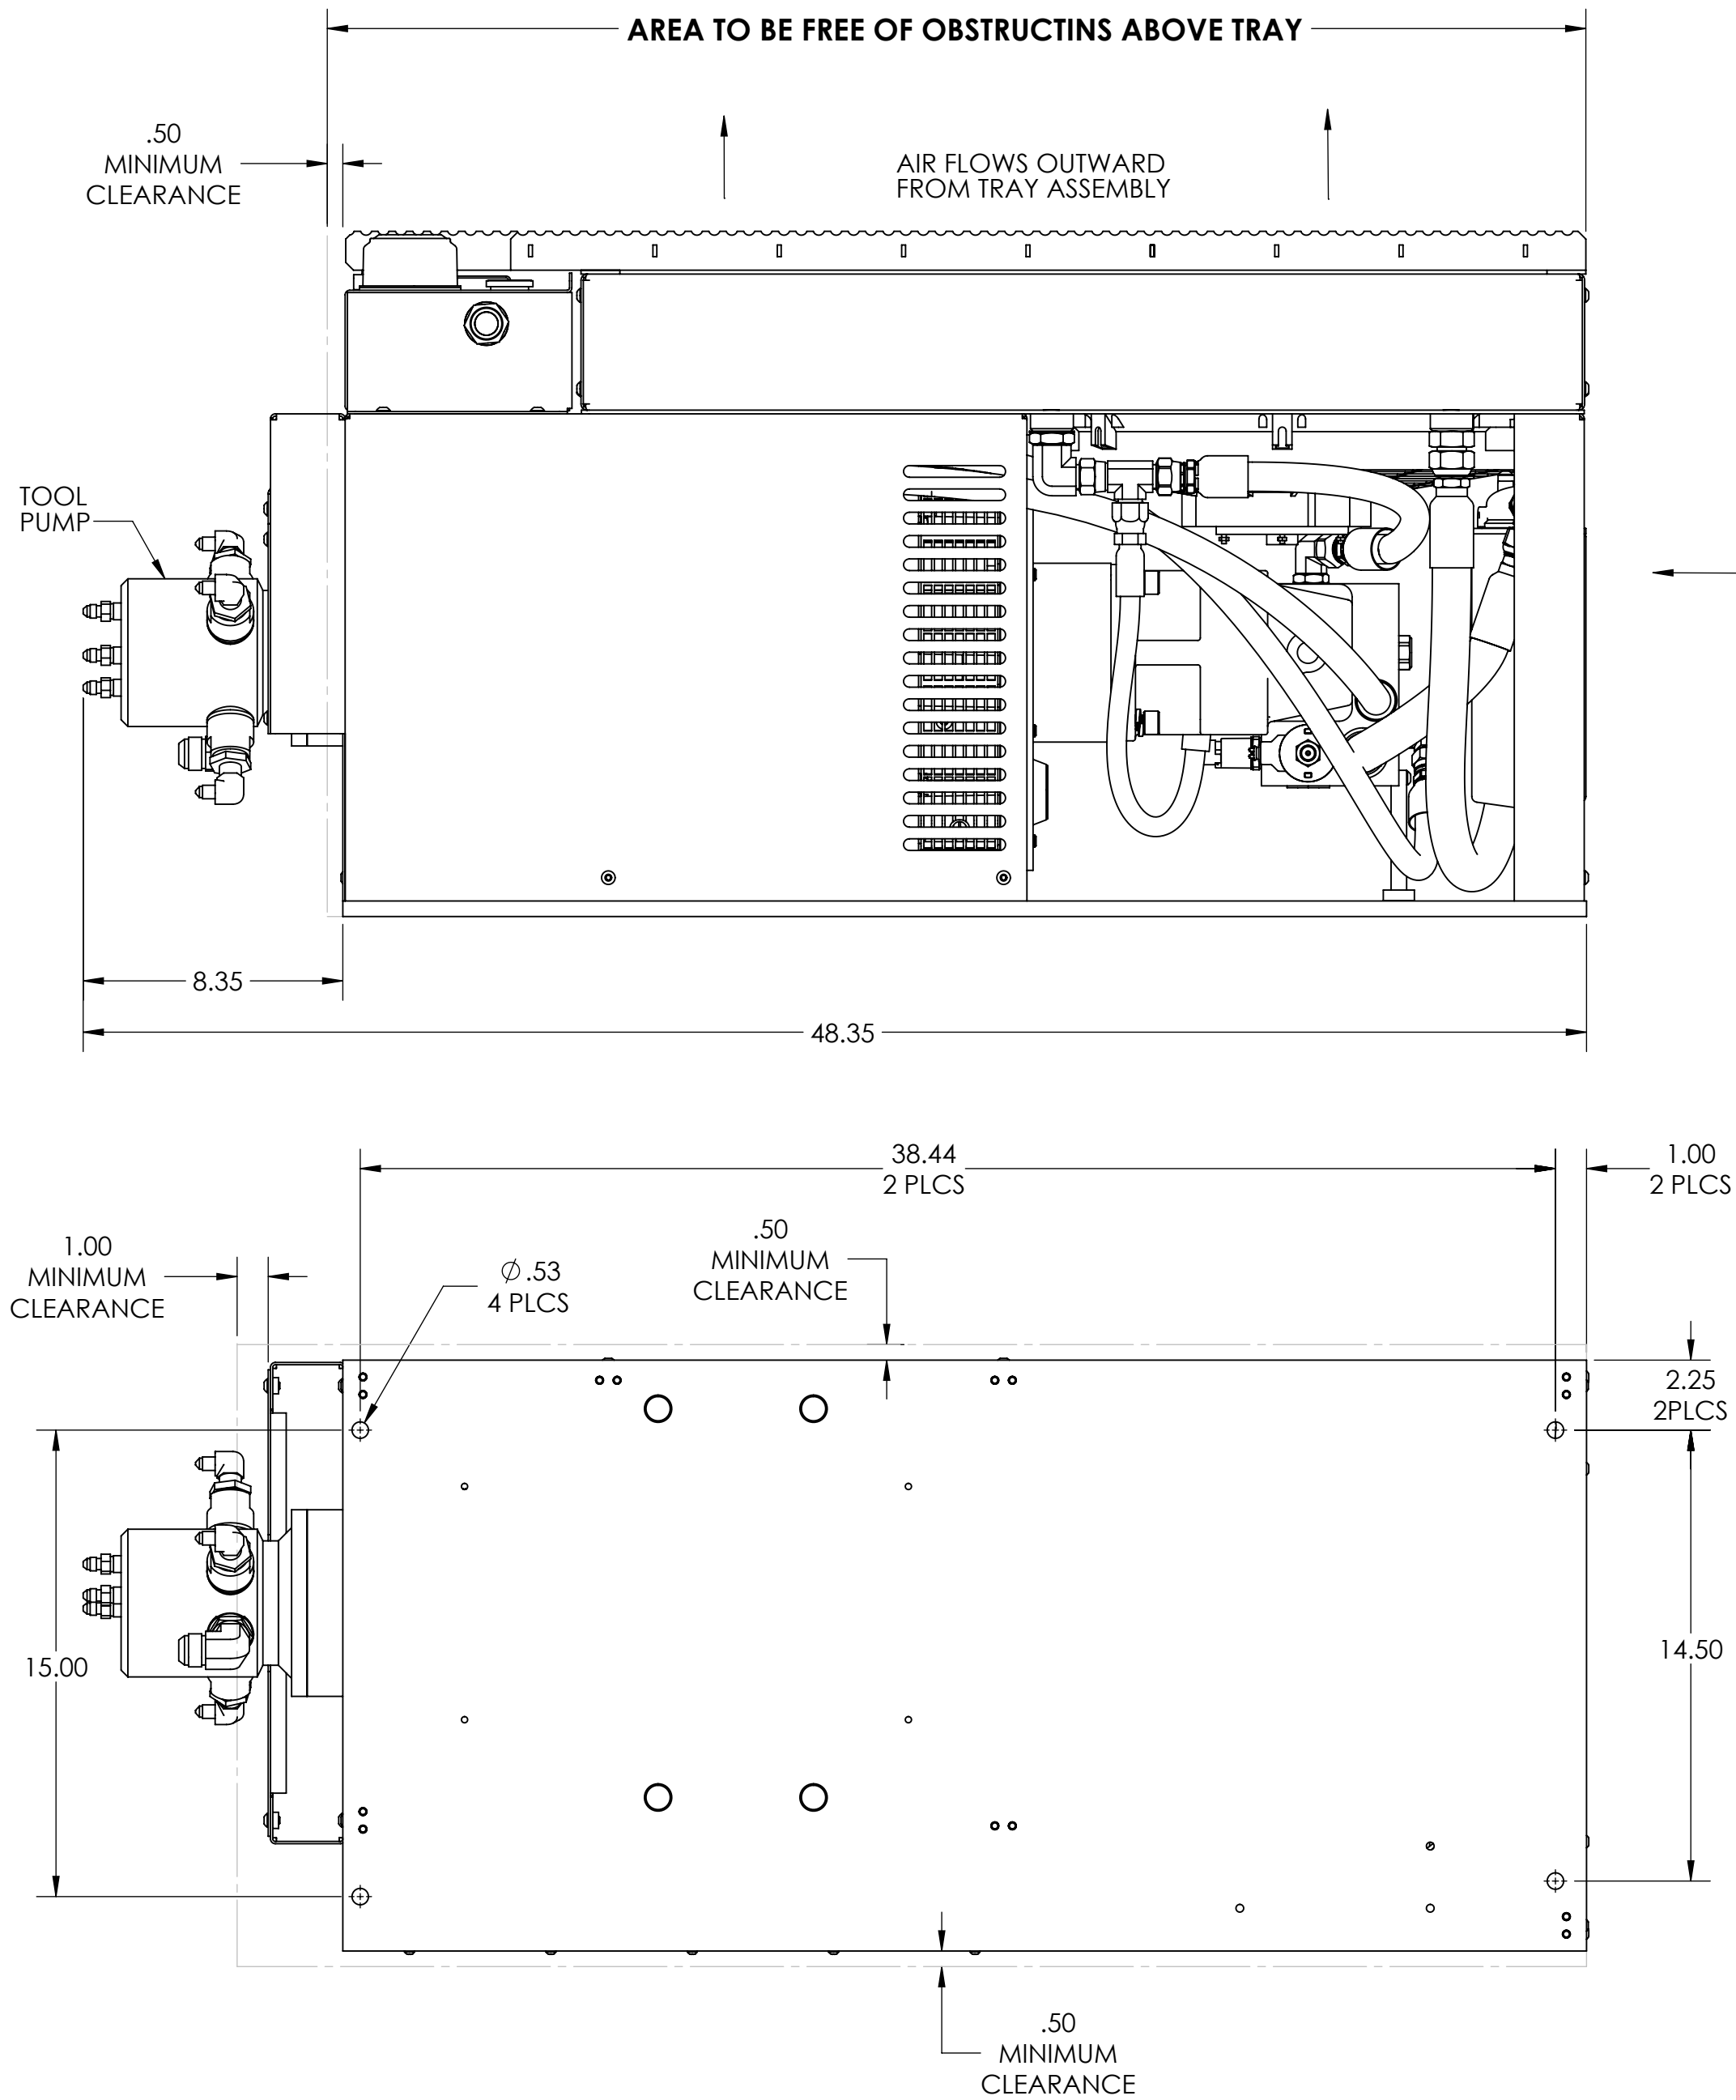


REVISIONS				
REV.	DATE	BY	DESCRIPTION	
B	01-26-2021	CML	REVISED AND REDRAWN FOR J1939 PER ECO #16463	

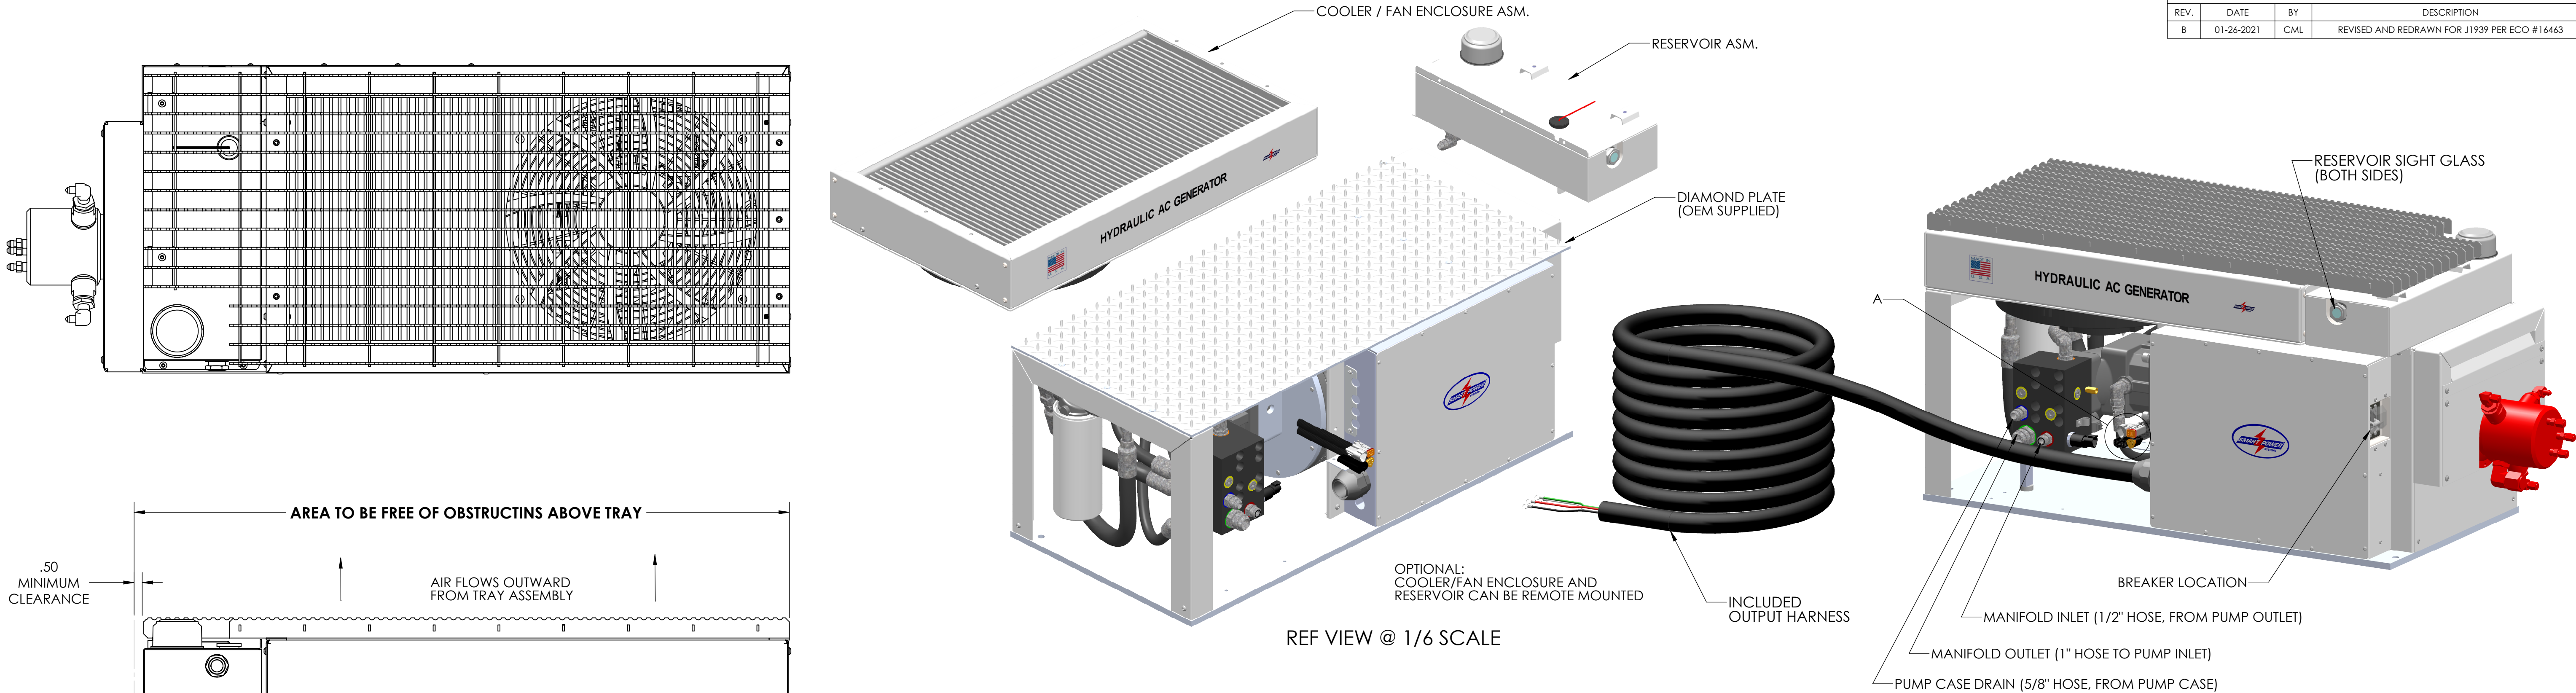

- NOTES:
- ASSEMBLY IS 100% PRODUCTION TESTED
 - DIMENSION TOLERANCE ± 0.125 UNLESS OTHERWISE STATED
 - RESERVOIR AND/OR COOLER ASSEMBLIES CAN BE REMOVED FROM TRAY ASSEMBLY FOR REMOTE MOUNTING (EXTENSION HARNESSES AVAILABLE)
 - TRAY ASSEMBLY MUST BE MOUNTED SO AS TO PREVENT RECIRCULATION OF HOT AIR EXHAUST FROM COOLER
 - GENERATOR OUTPUT WIRE ASSEMBLY: 20FT $\pm$ 1 FT LENGTH
GREEN WIRE, 4AWG - GROUND
WHITE WIRE, 4AWG - NEUTRAL
BLACK WIRE, 4AWG - 240V, L1
RED WIRE, 4AWG - 240V, L2
CONDUIT, FNMC
 - REF. DRAWING 36XXXXX MODEL MATRIX FOR SYSTEM DETAILS

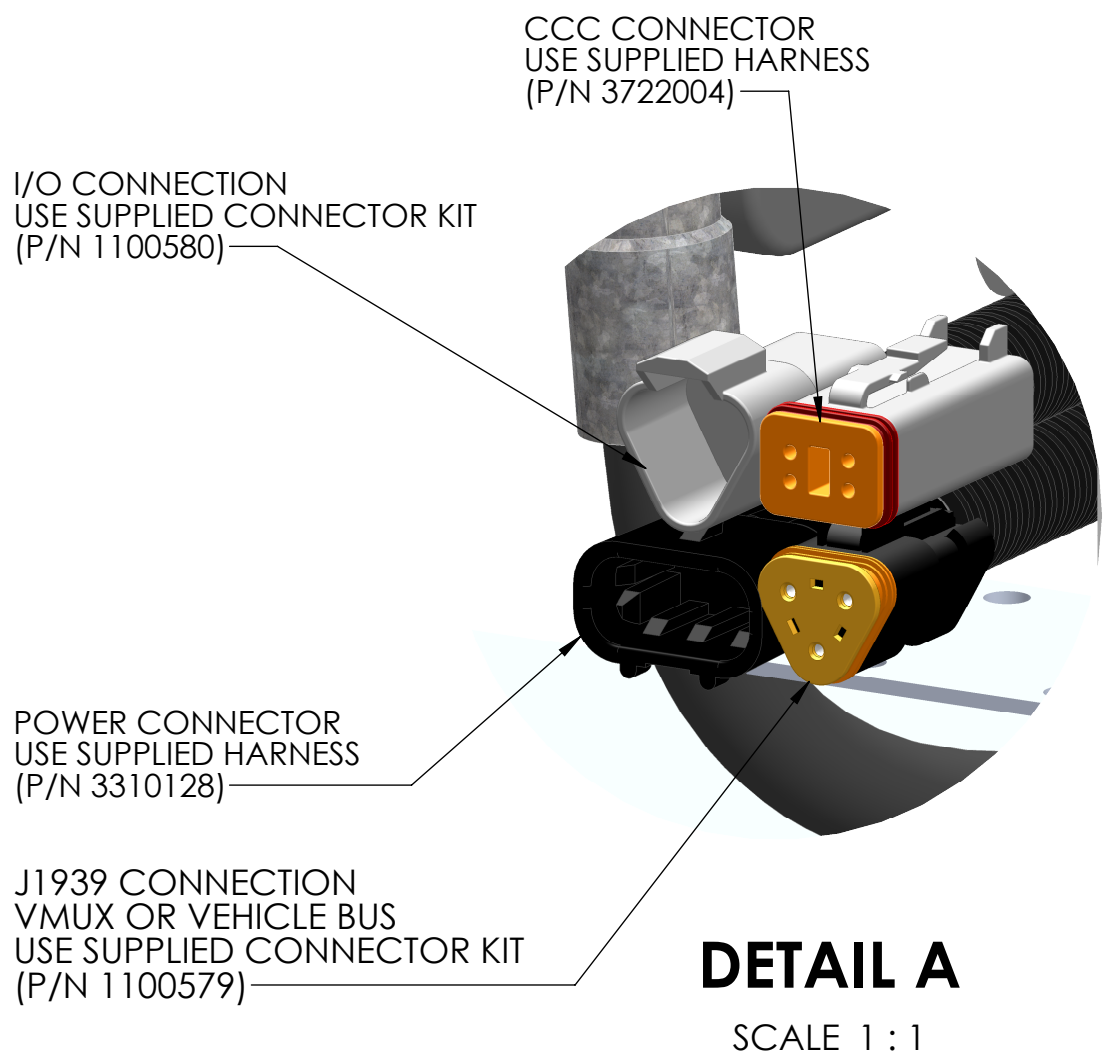

SW COMPUTER GRAPHICS
NO HAND REVISIONS

THIS DOCUMENT IS THE PROPERTY OF NARTRON AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN NARTRON AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS INFORMATION CONTAINED HEREIN OR TO REPRODUCE ALL OR ANY PART OF THIS DOCUMENT.

DELIVERY OF THIS DOCUMENT BY NARTRON CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.

PROPRIETARY DATA
STRICTLY CONFIDENTIAL
NARTRON

SPECIFICATION CONTROL DRAWING

DRAWN	DATE	REQ'D	ITEM	PART NO	DESCRIPTION
RJB	05-20-09		DO NOT SCALE		LIST OF MATERIALS
CHECKED	DATE		DIMENSIONS ARE IN INCHES		
AEB	06-12-09				
APPROVED	DATE		TOLERANCE UNLESS OTHERWISE SPECIFIED		
TPK	06-12-09				
MATERIAL			2 PLACE DECIMALS ± 0.01		
			3 PLACE DECIMALS ± 0.005		
NEXT ASSEMBLY			ANGLES $\pm 1/2^\circ$	SCALE 1:5	NO
			THDS. INT 2B EXT 2A	SHEET 1 of 1	

SMART POWER ENERGY

REED CITY, MI 49677
DIVISION

ELECTRONIC CONTROL TRAY ASM, LI-20

8585060