
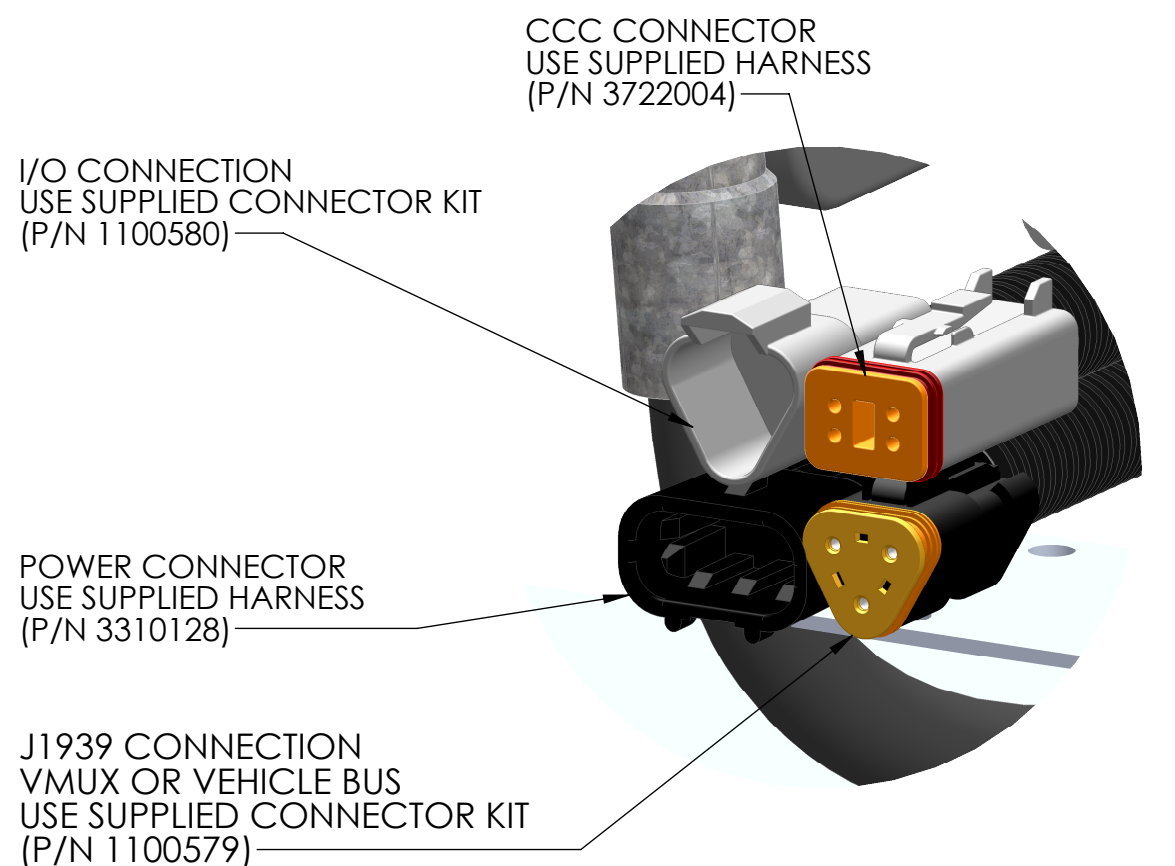
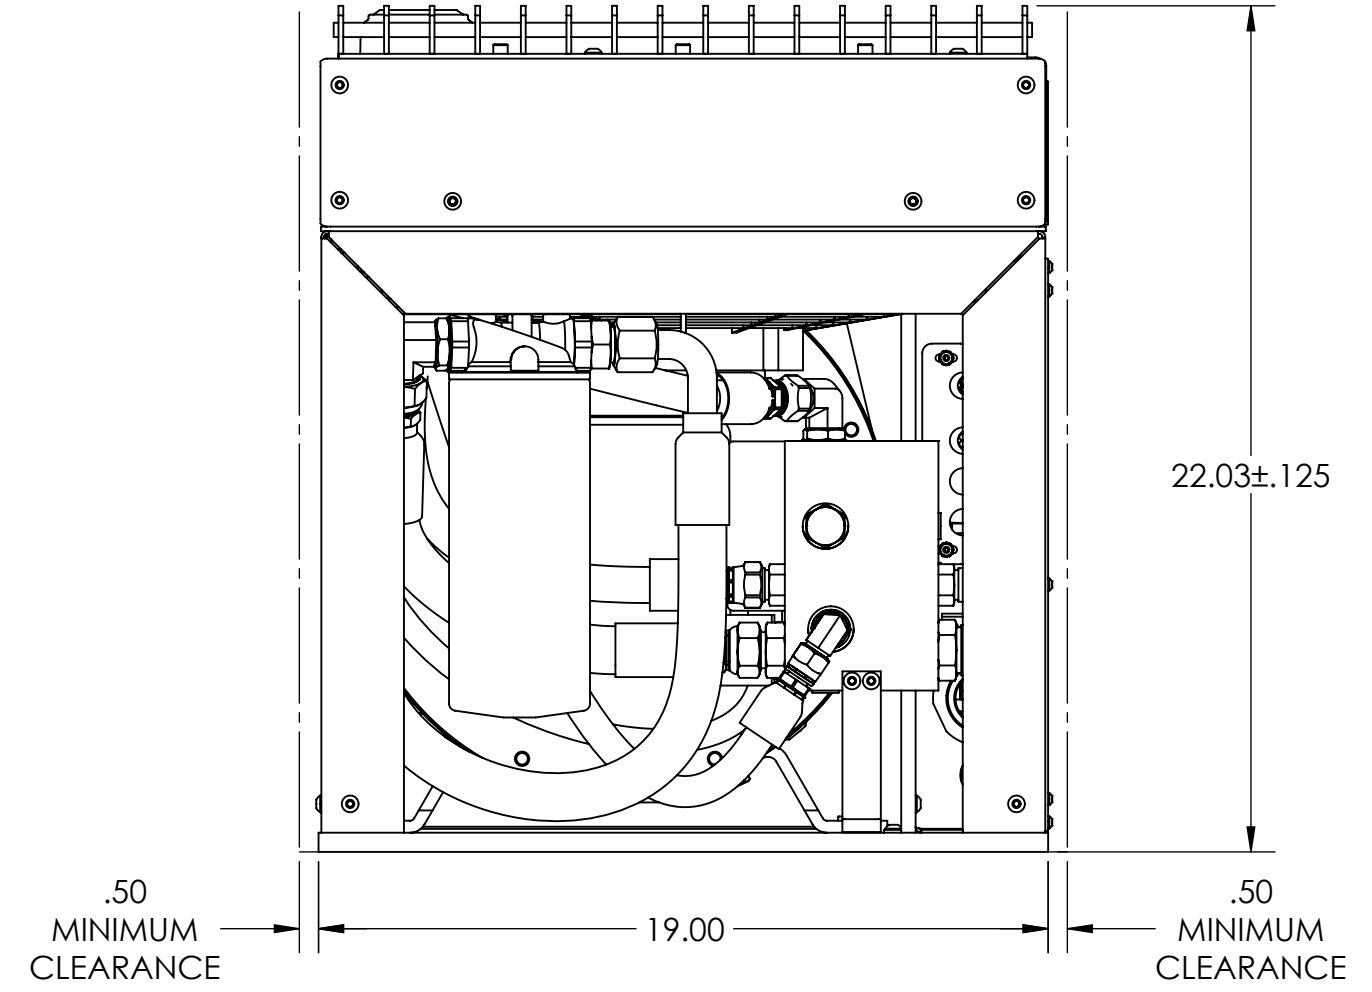
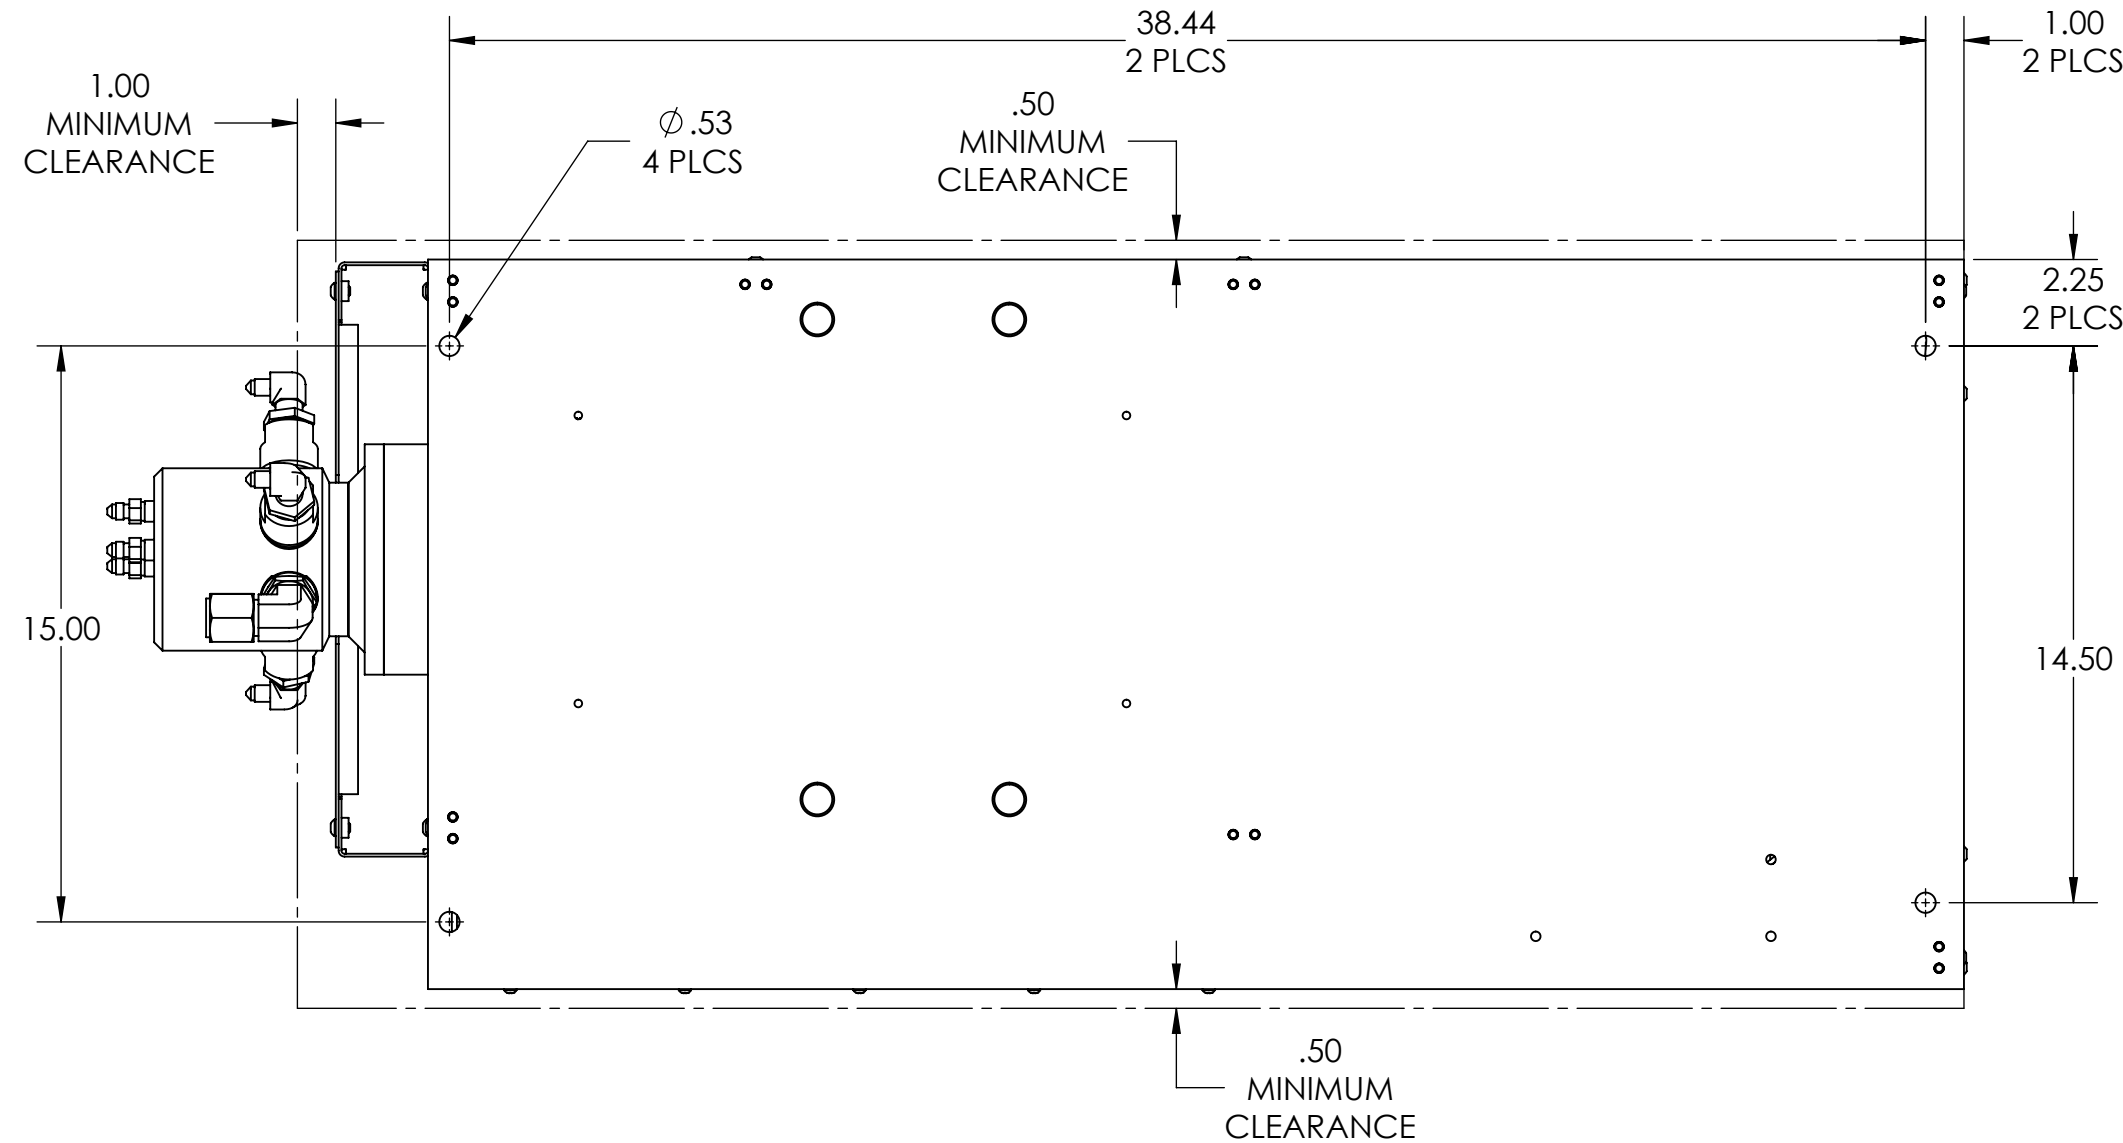
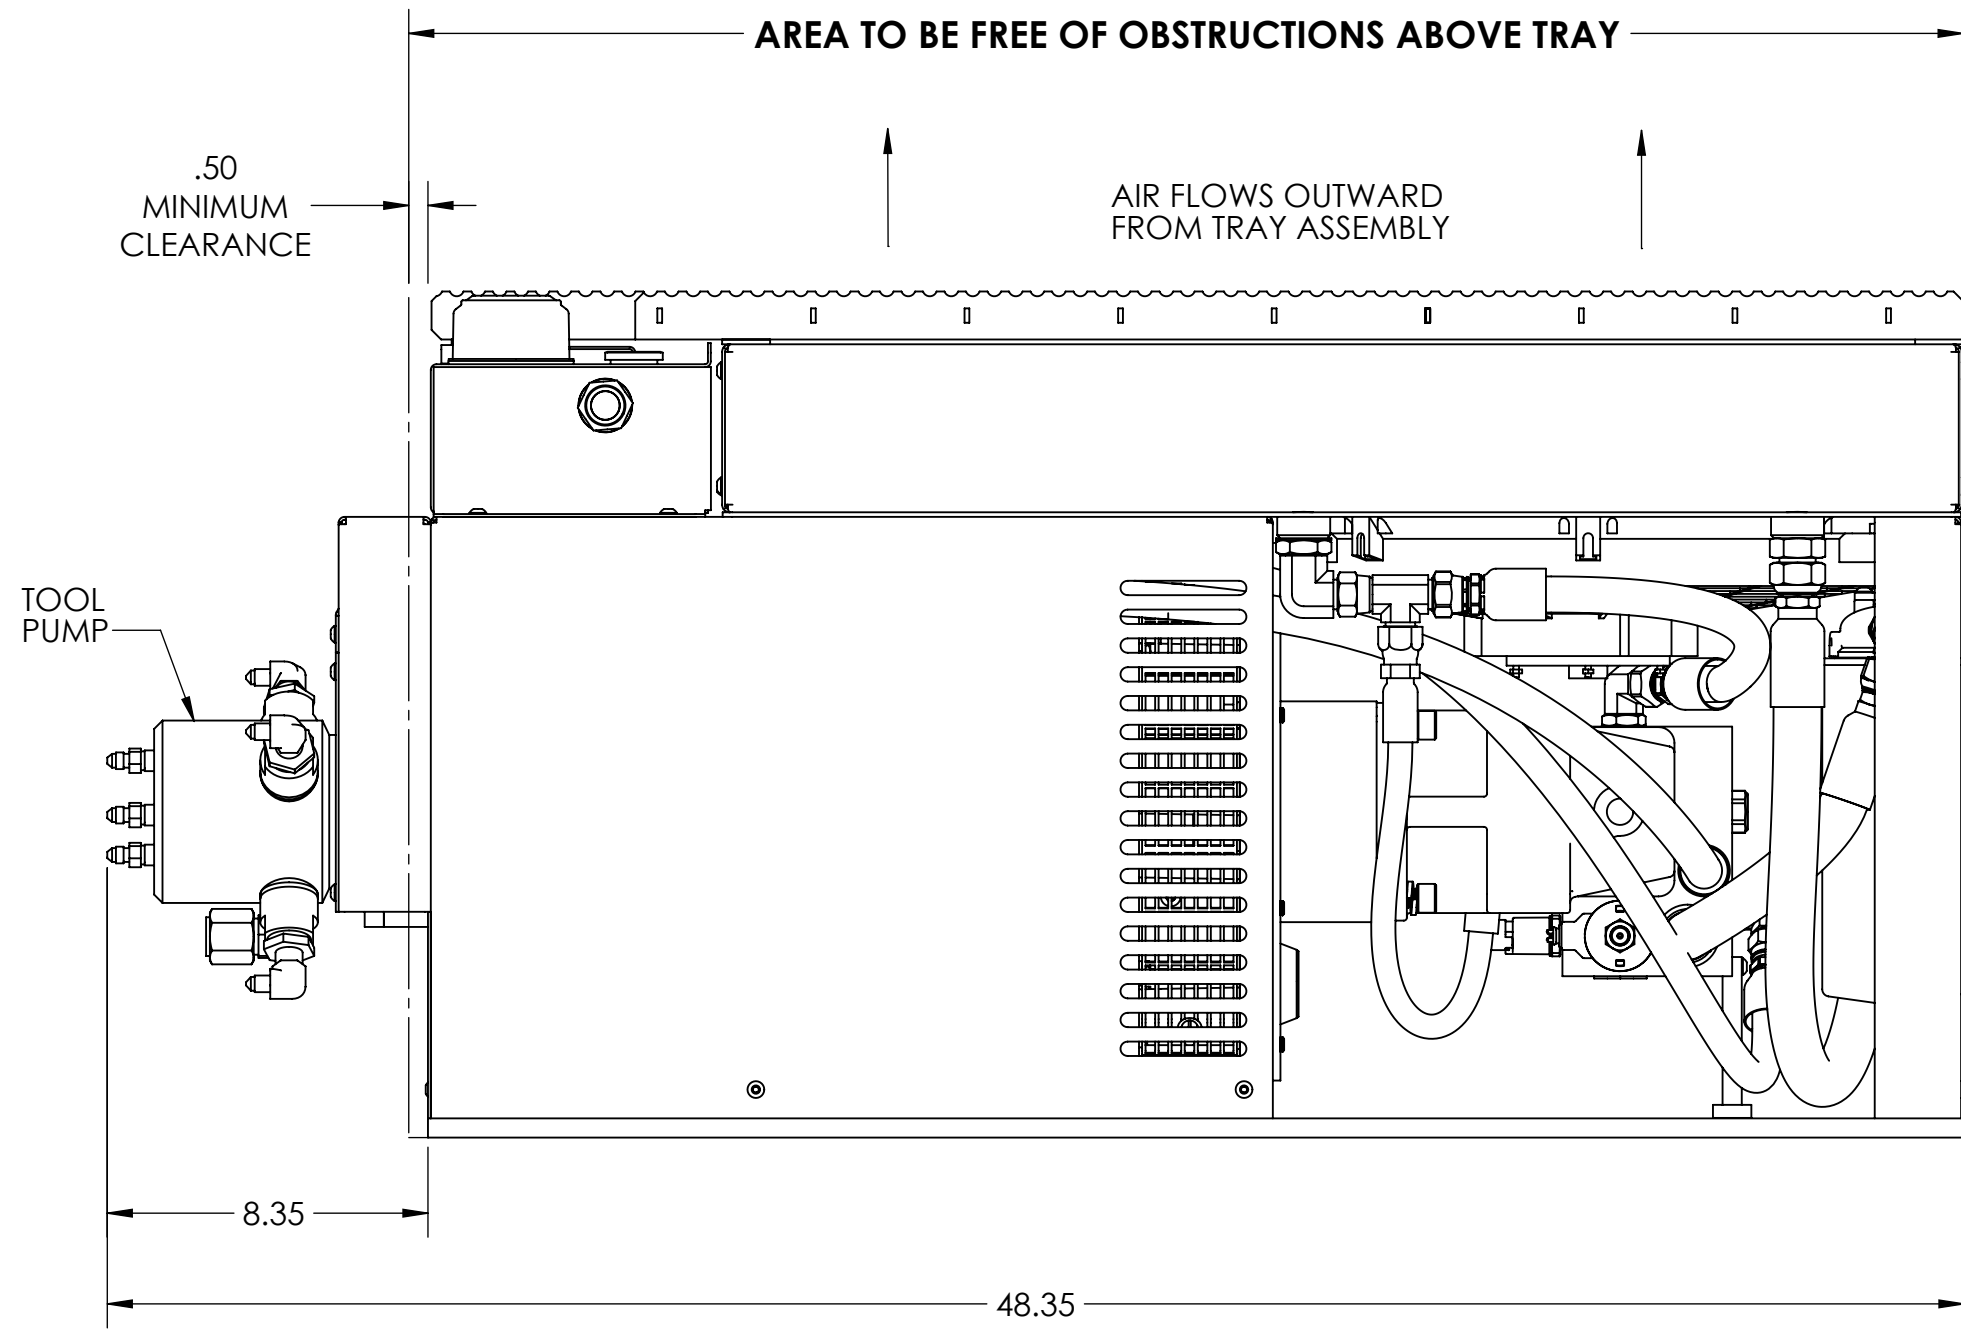


REVISIONS			
REV.	DATE	BY	DESCRIPTION
B	01-26-2021	CML	REVISED AND REDRAWN FOR J1939 PER ECO #16463

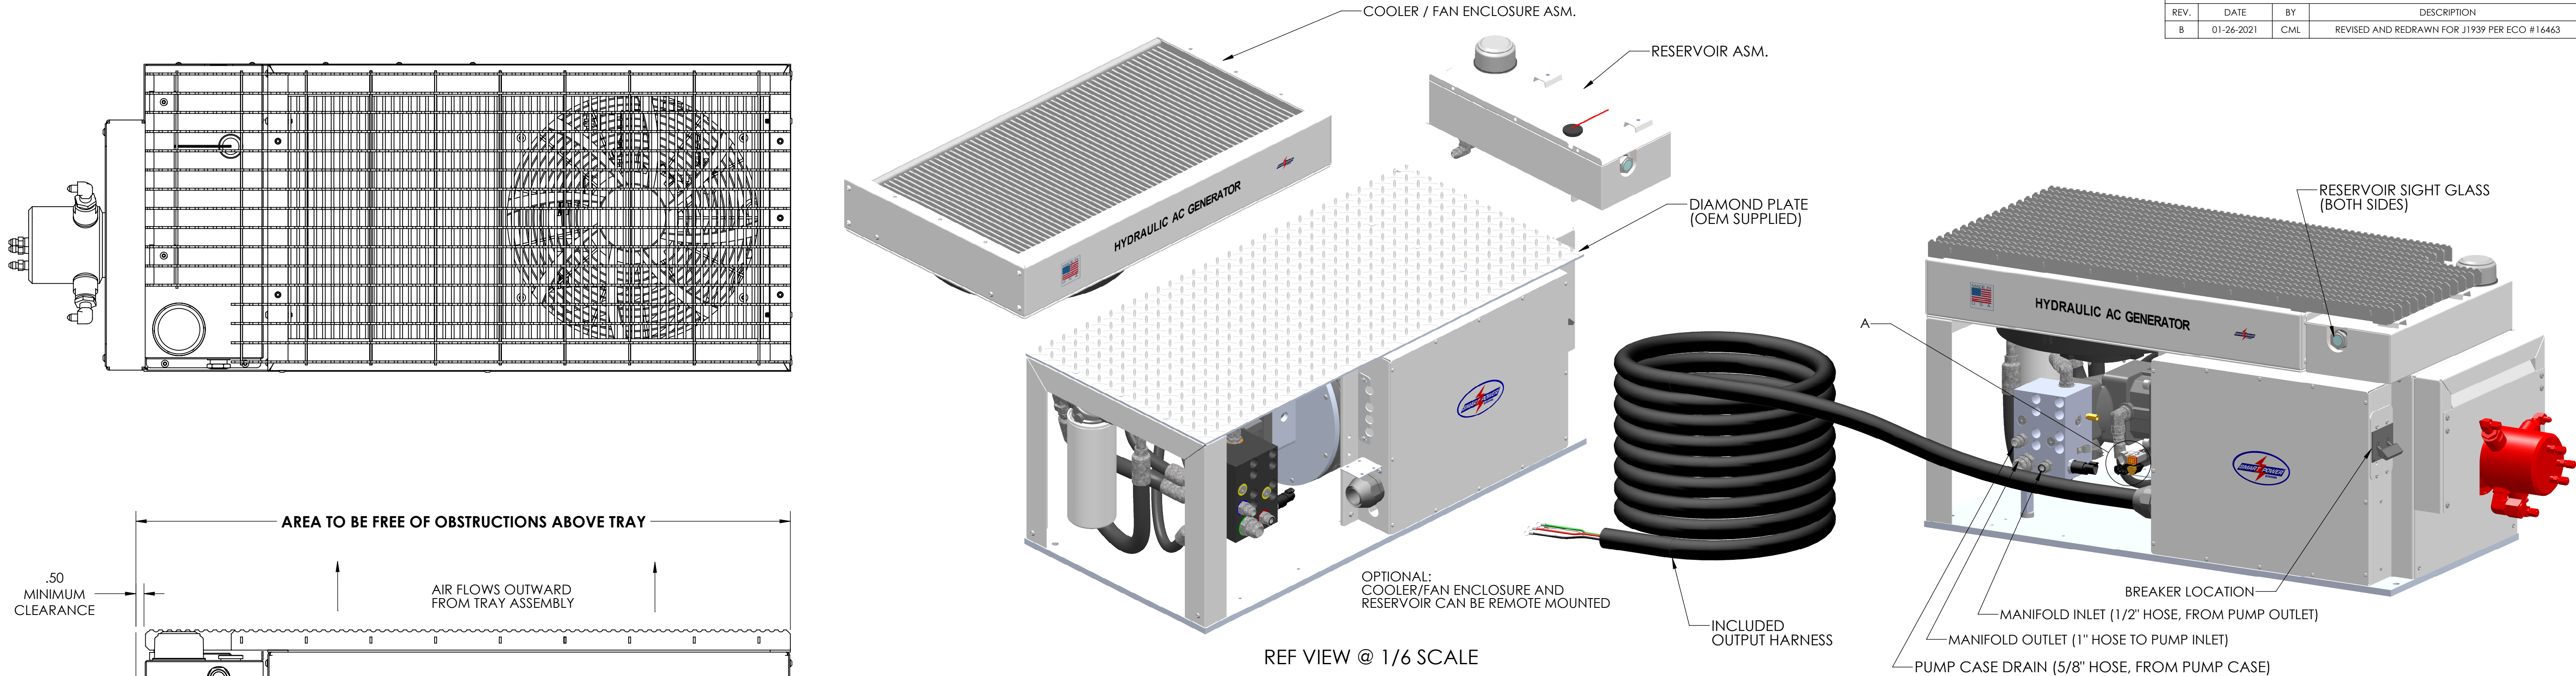

- NOTES:
- ASSEMBLY IS 100% PRODUCTION TESTED
 - DIMENSION TOLERANCE ± 0.125 UNLESS OTHERWISE STATED
 - RESERVOIR AND/OR COOLER ASSEMBLIES CAN BE REMOVED FROM TRAY ASSEMBLY FOR REMOTE MOUNTING (EXTENSION HARNESSES AVAILABLE)
 - TRAY ASSEMBLY MUST BE MOUNTED SO AS TO PREVENT RECIRCULATION OF HOT AIR EXHAUST FROM COOLER
 - GENERATOR OUTPUT WIRE ASSEMBLY: 20FT $\pm$ 1FT
GREEN WIRE, 2AWG - GROUND
WHITE WIRE, 2AWG - NEUTRAL
BLACK WIRE, 2AWG - 240V, L1
RED WIRE, 2AWG - 240V, L2
CONDUIT, FNMIC
 - REF. DRAWING 36XXXXX MODEL MATRIX FOR SYSTEM DETAILS

SW

COMPUTER GRAPHICS
NO HAND REVISIONS

THIS DOCUMENT IS THE PROPERTY OF NARTRON AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN NARTRON AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS INFORMATION CONTAINED HEREIN OR TO REPRODUCE ALL OR ANY PART OF THIS DOCUMENT.

DELIVERY OF THIS DOCUMENT BY NARTRON CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.

PROPRIETARY DATA
STRICTLY CONFIDENTIAL
NARTRON

SPECIFICATION CONTROL DRAWING

DRAWN	DATE	REQ'D	ITEM	PART NO	DESCRIPTION
RJB	04-29-10	DO NOT SCALE			LIST OF MATERIALS
CHECKED	DATE	DIMENSIONS	ARE IN INCHES		
TPK	05-13-11				
APPROVED	DATE	TOLERANCE UNLESS OTHERWISE SPECIFIED			
AEB	05-13-11				
MATERIAL		2 PLACE DECIMALS ± 0.01			
		3 PLACE DECIMALS ± 0.005			
NEXT ASSEMBLY		ANGLES $\pm 1/2^\circ$	SCALE	1:5	NO
		THDS. INT 2B EXT 2A	SHEET	1 of 1	

SMART POWER
ENERGETICS

ELECTRONIC CONTROL TRAY ASM,
LI-25

8585065